



a

Clear Dose Response

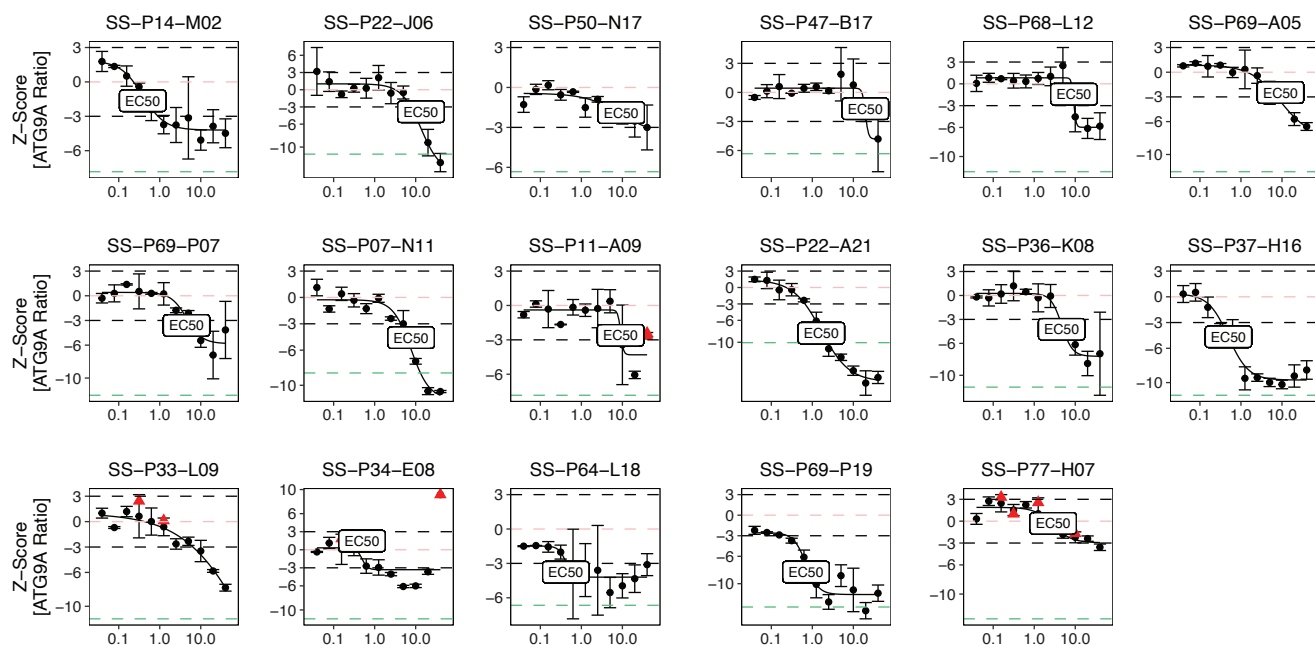


b


Evidence of Autofluorescence or Imaging Artifacts

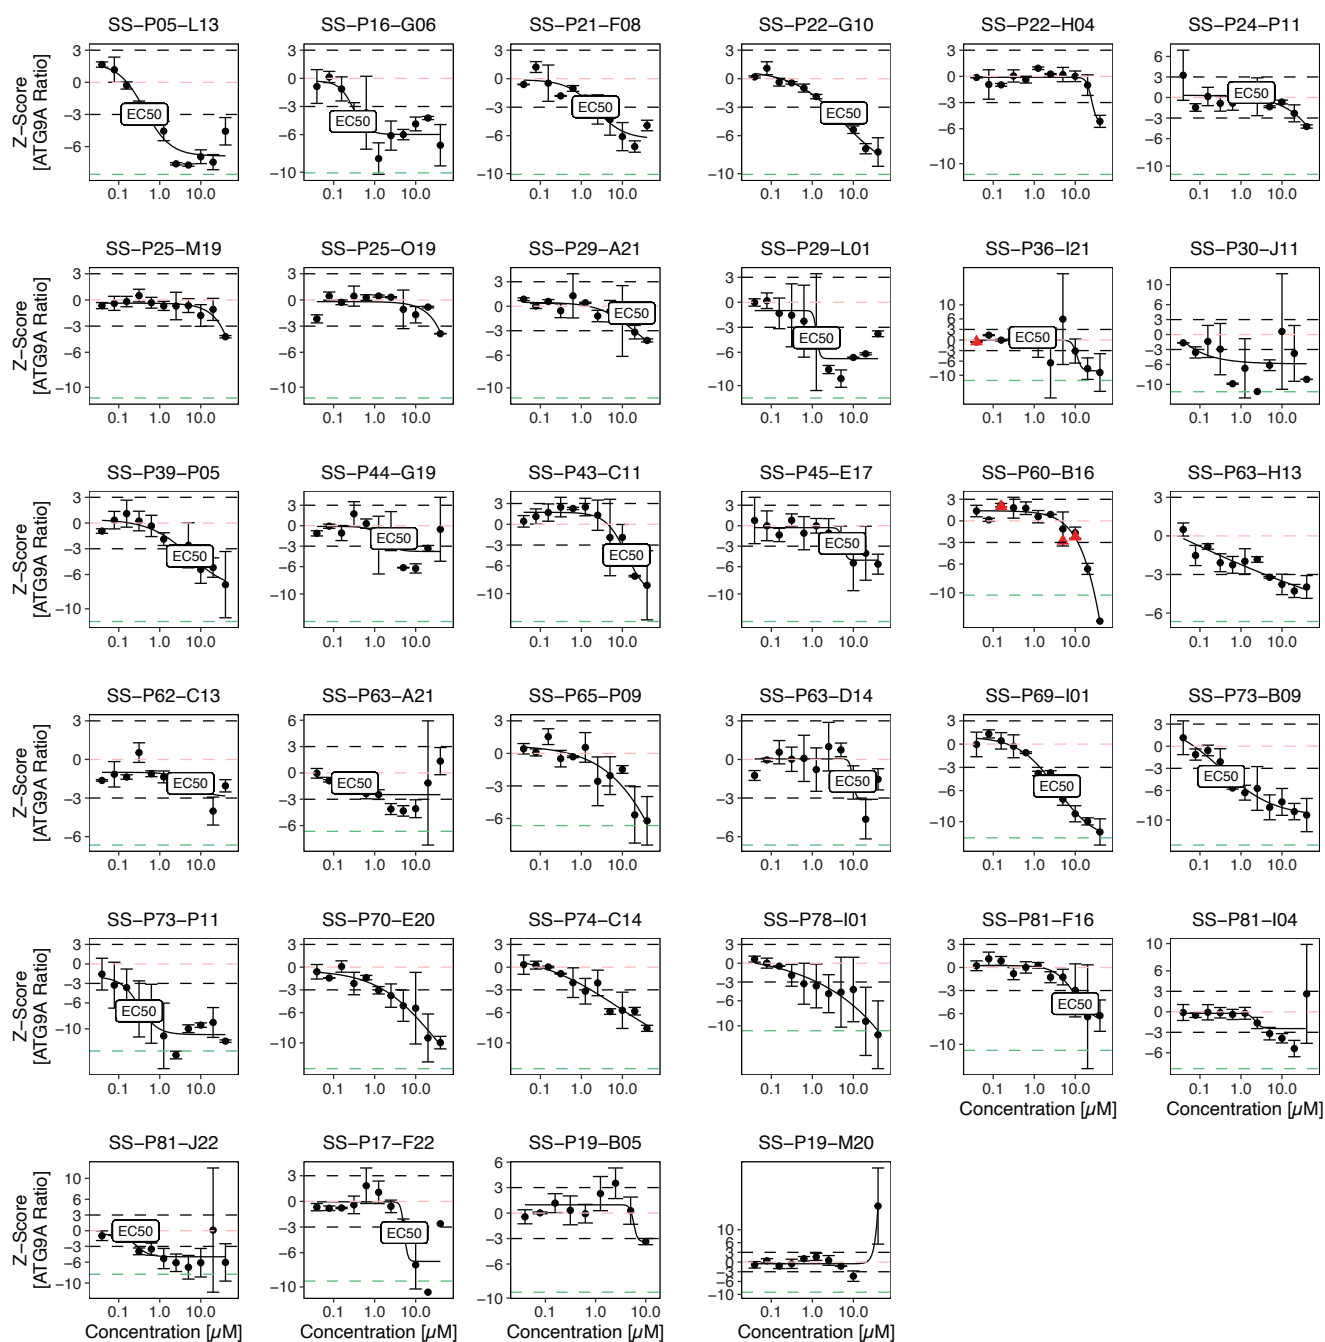


C

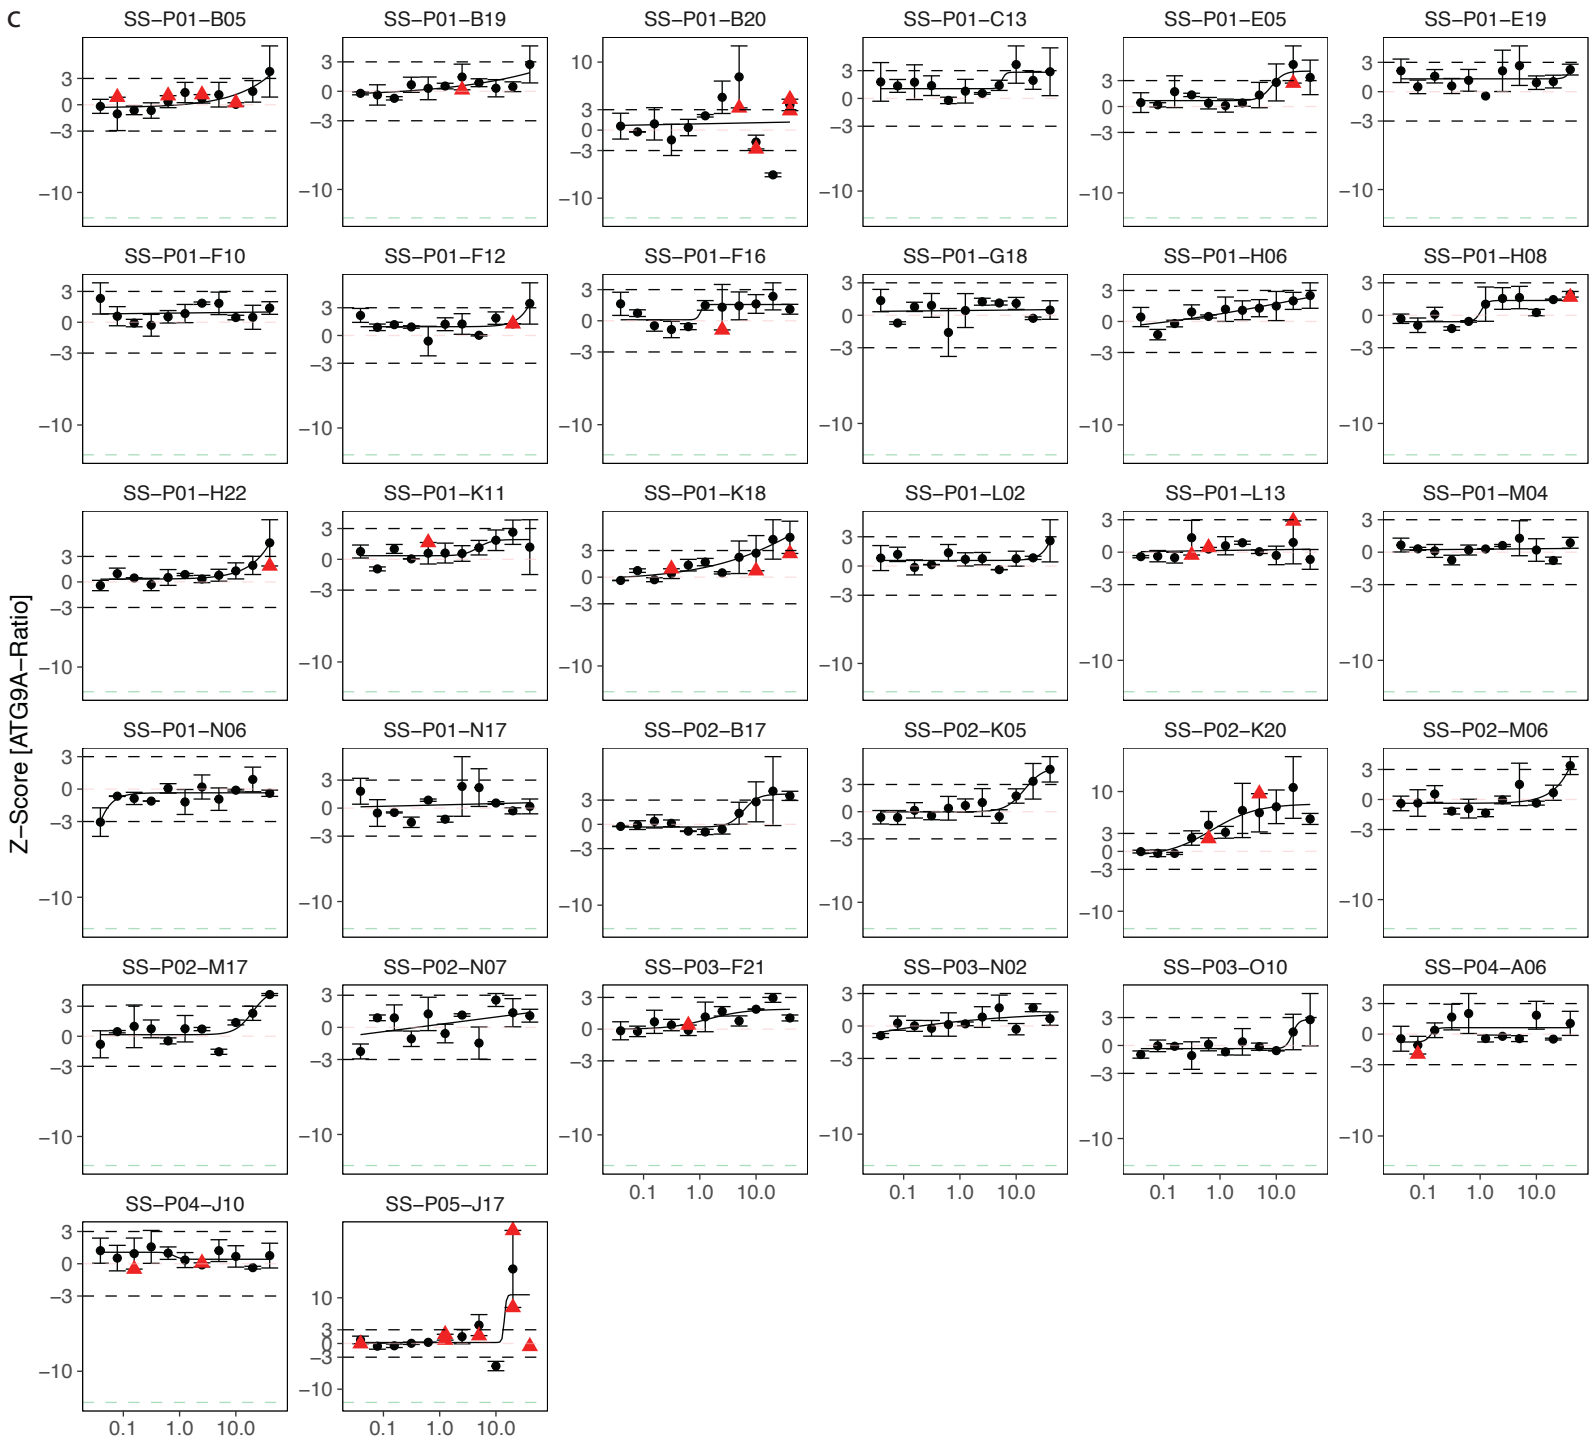


Secondary Screen – Plate 1

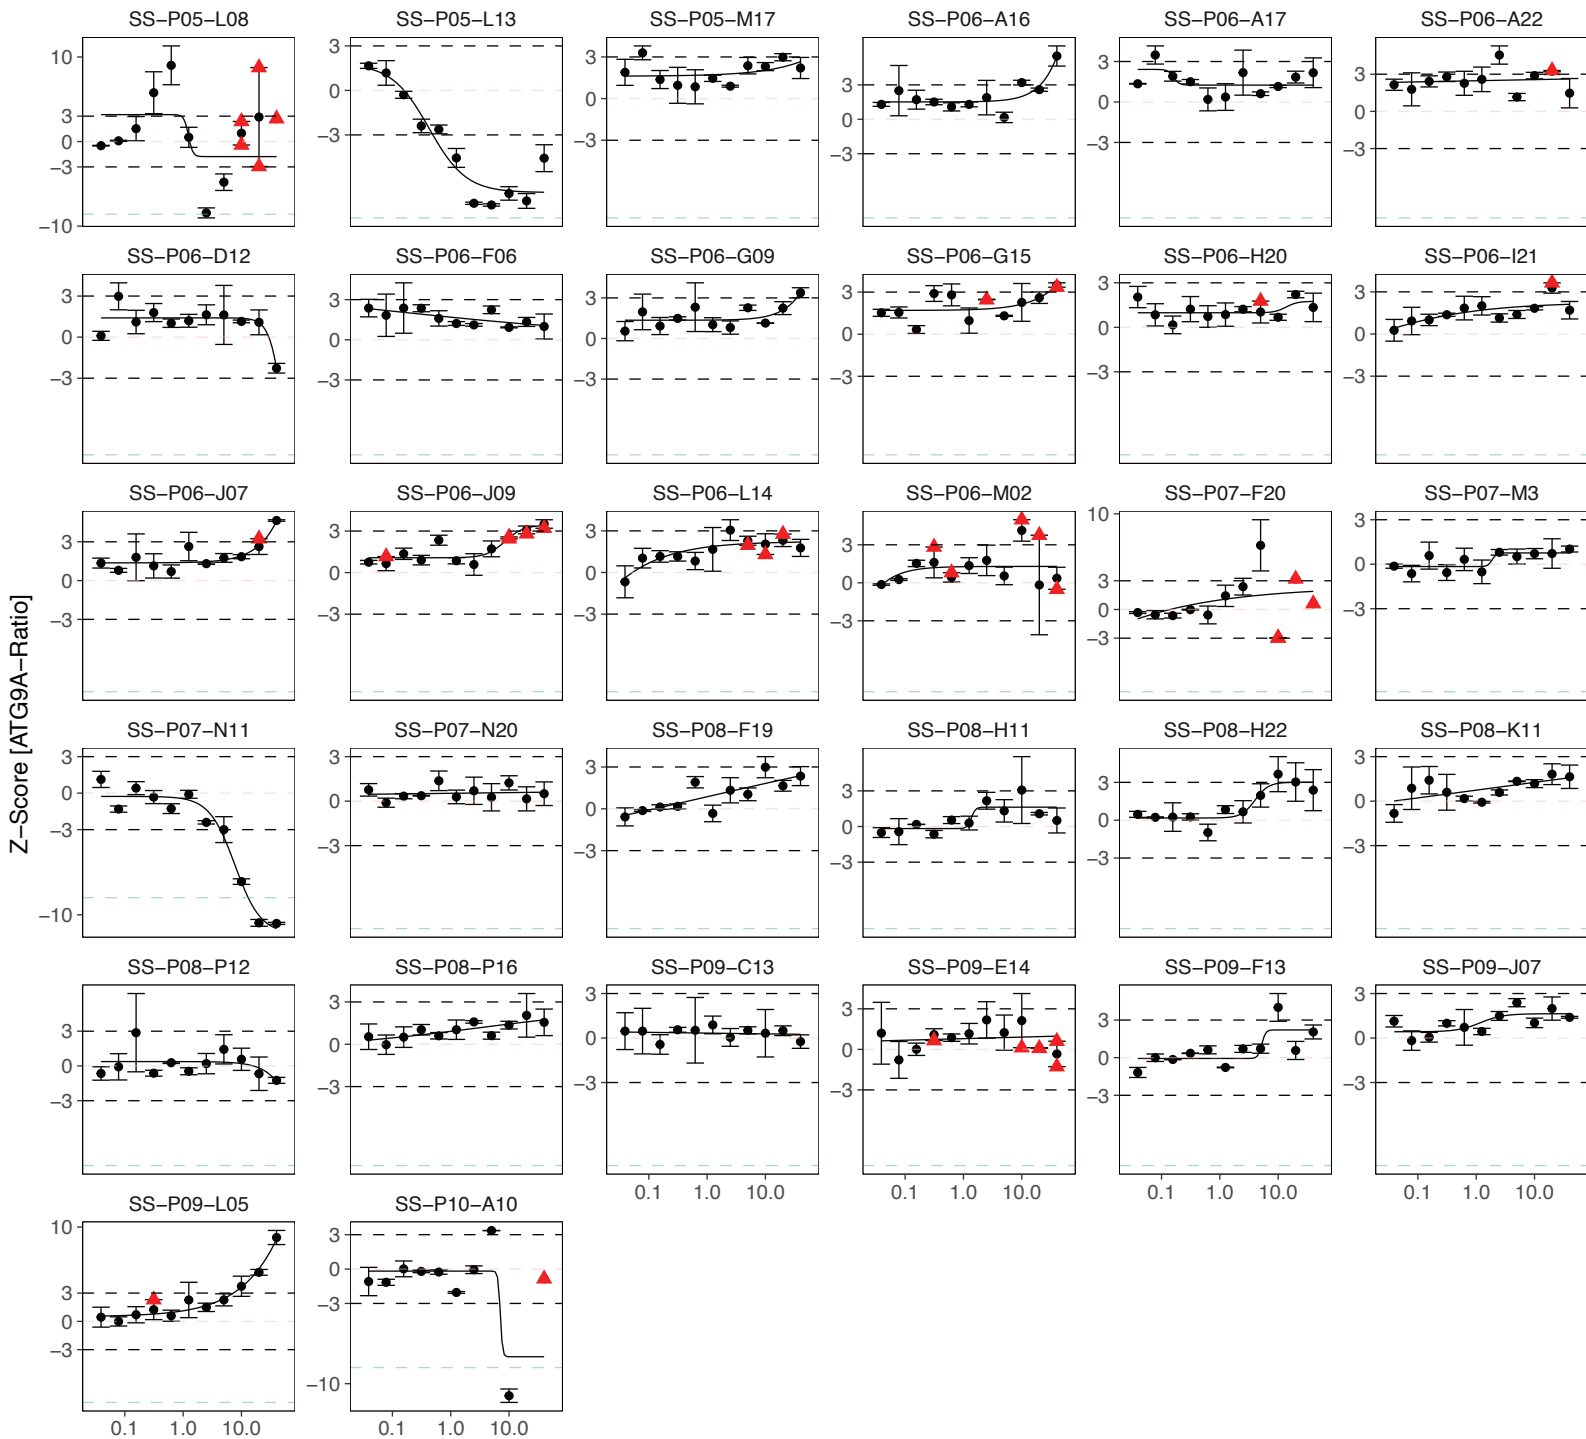


Secondary Screen – Plate 2

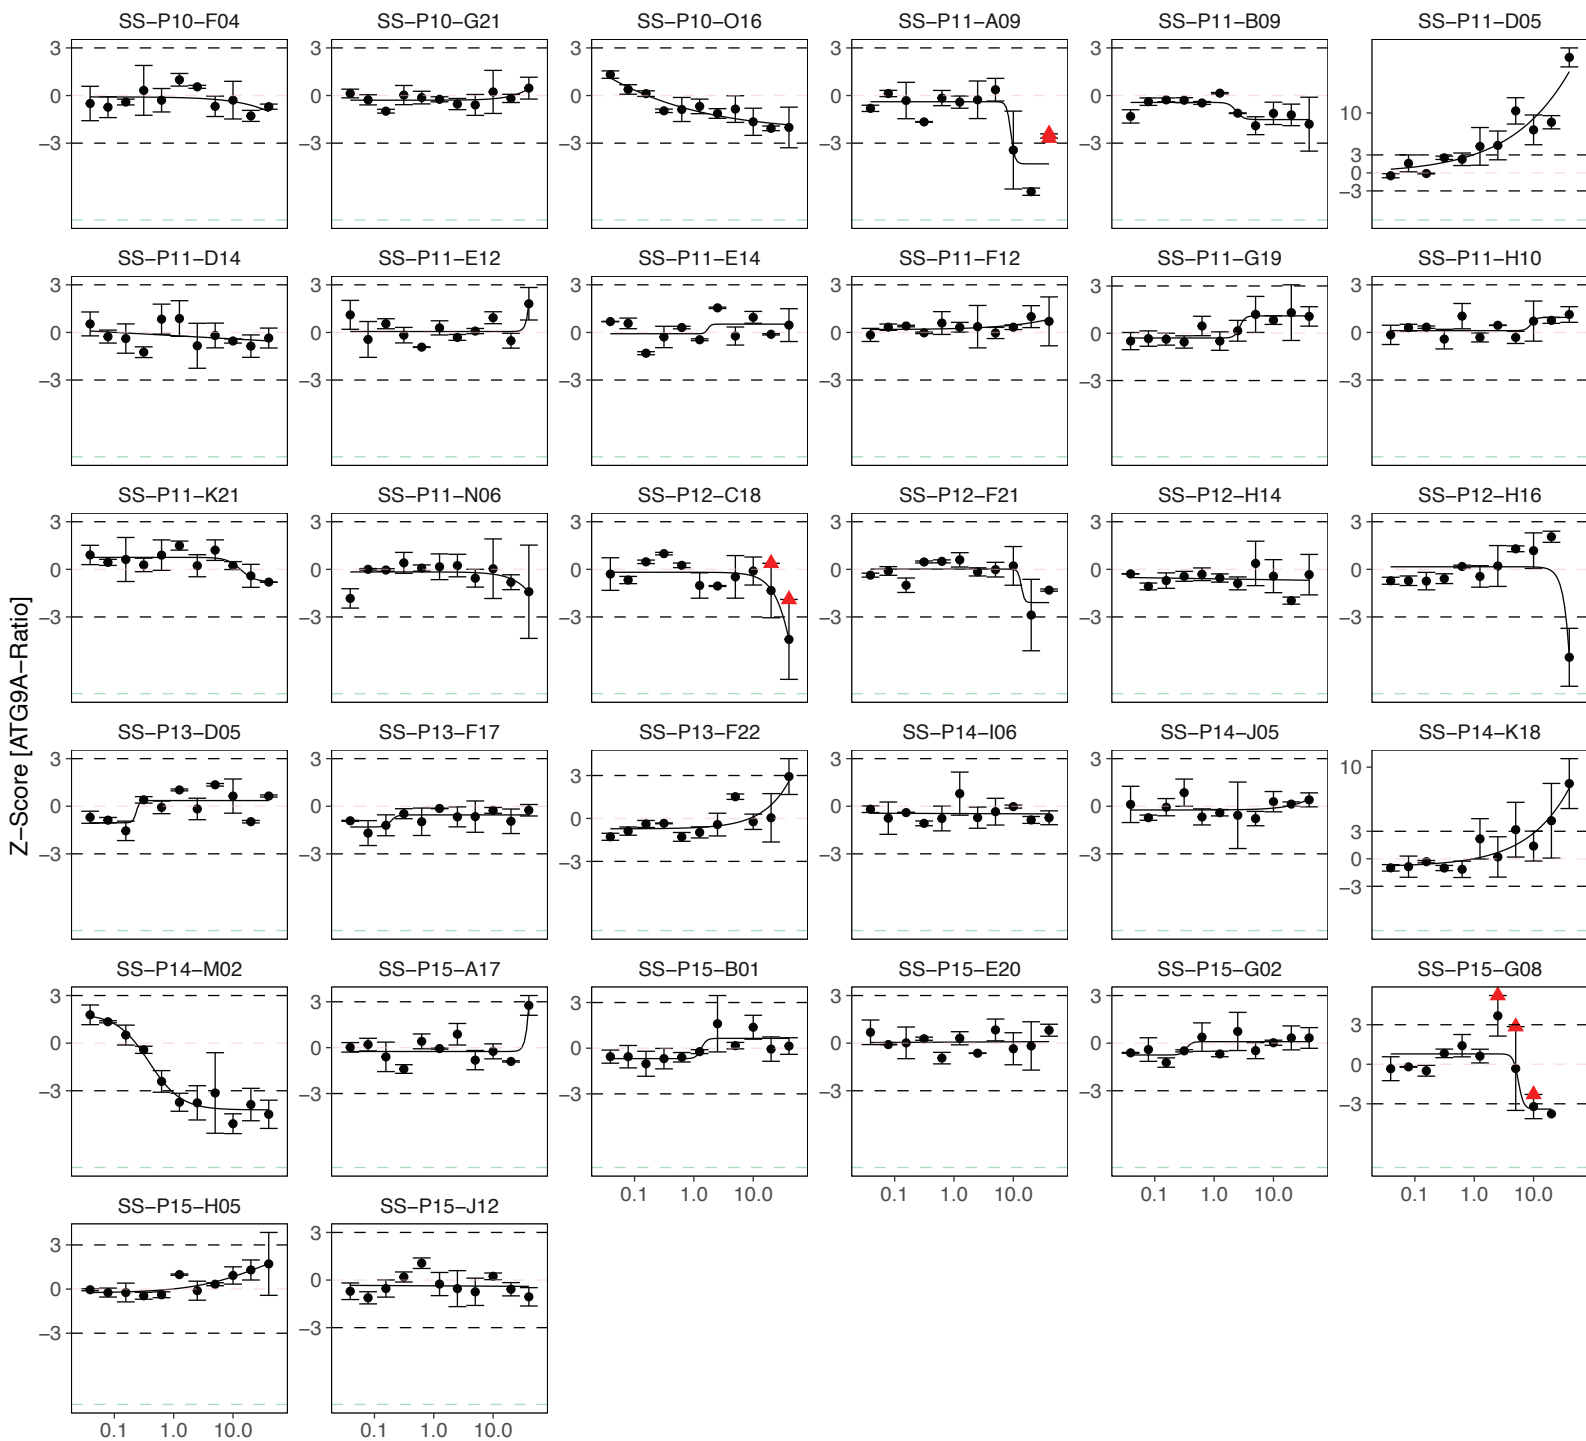


Secondary Screen – Plate 3

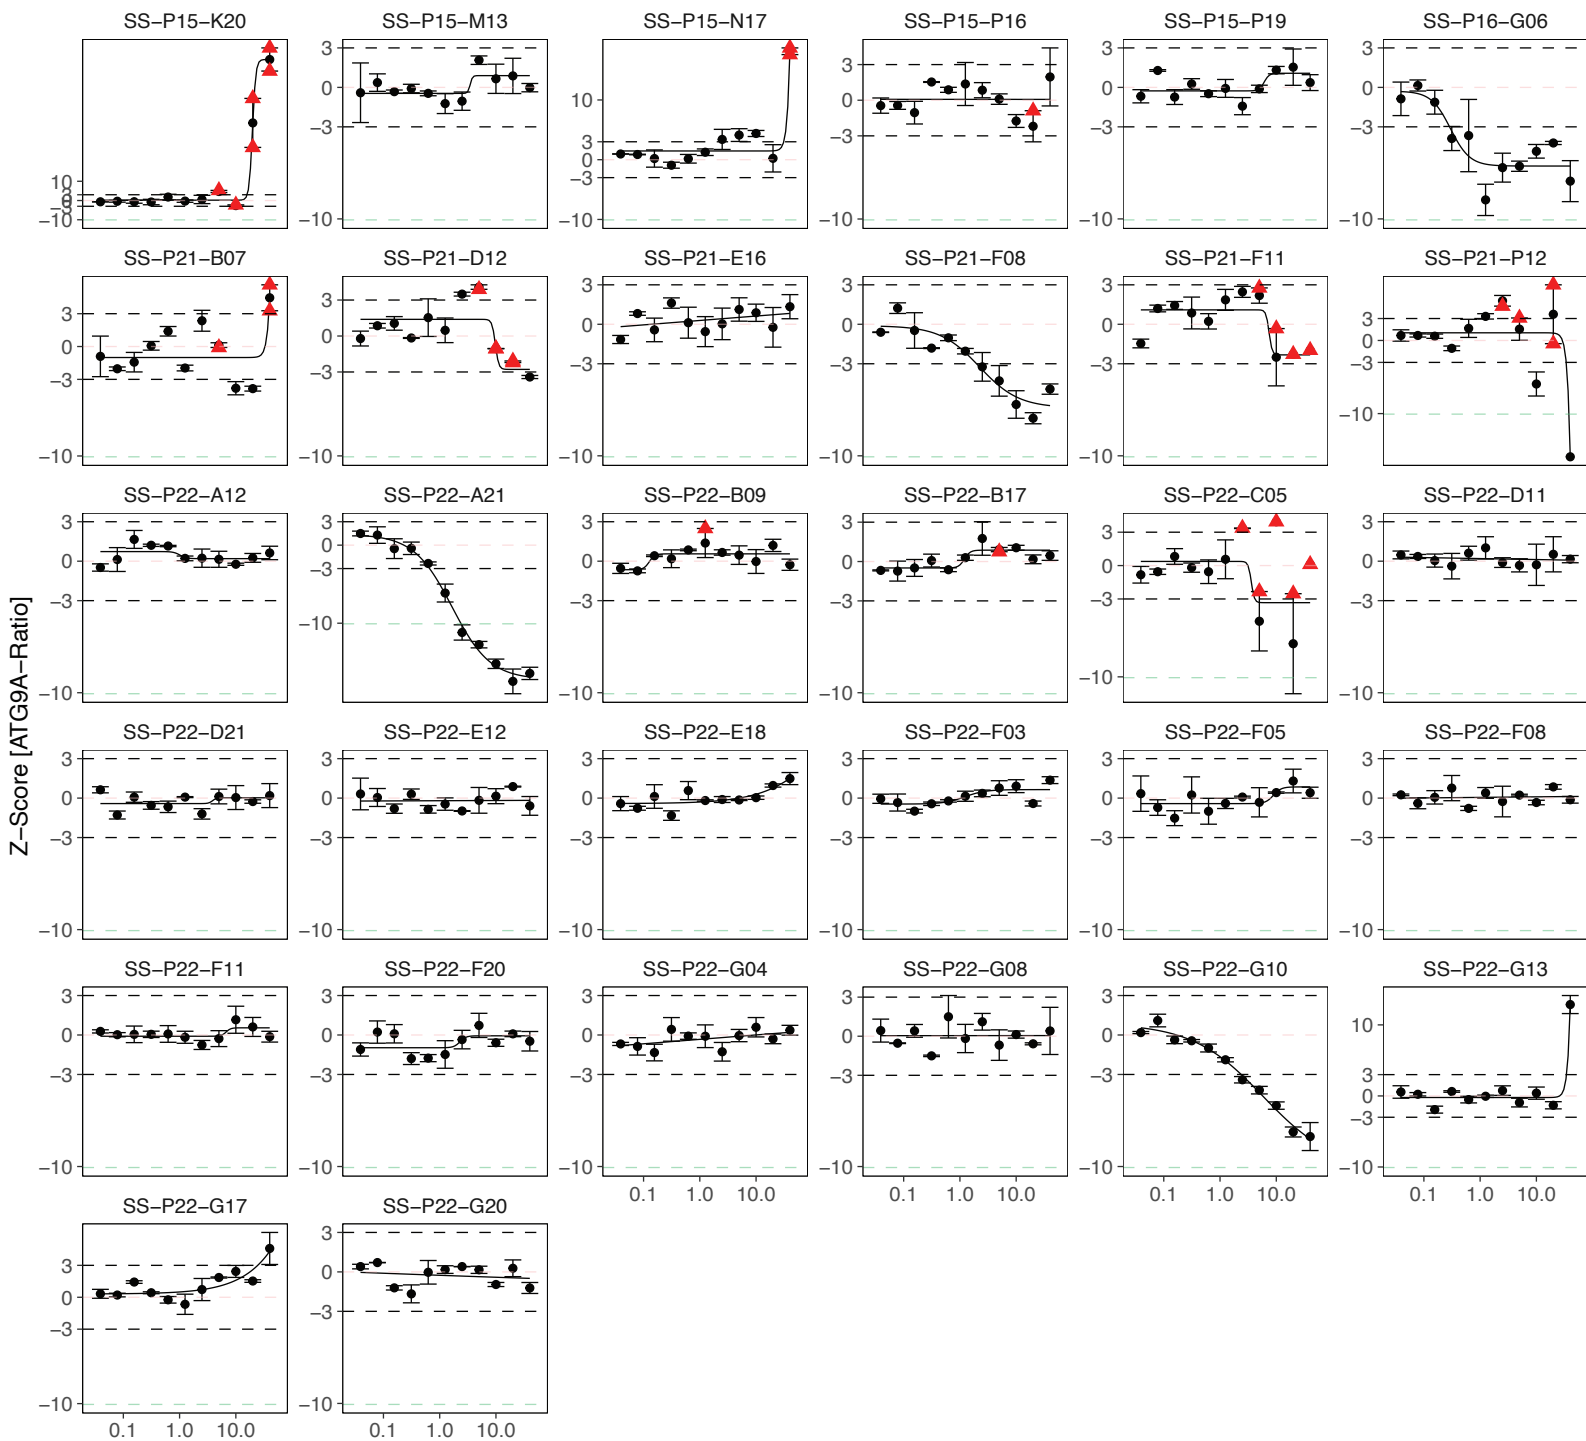


Secondary Screen – Plate 4

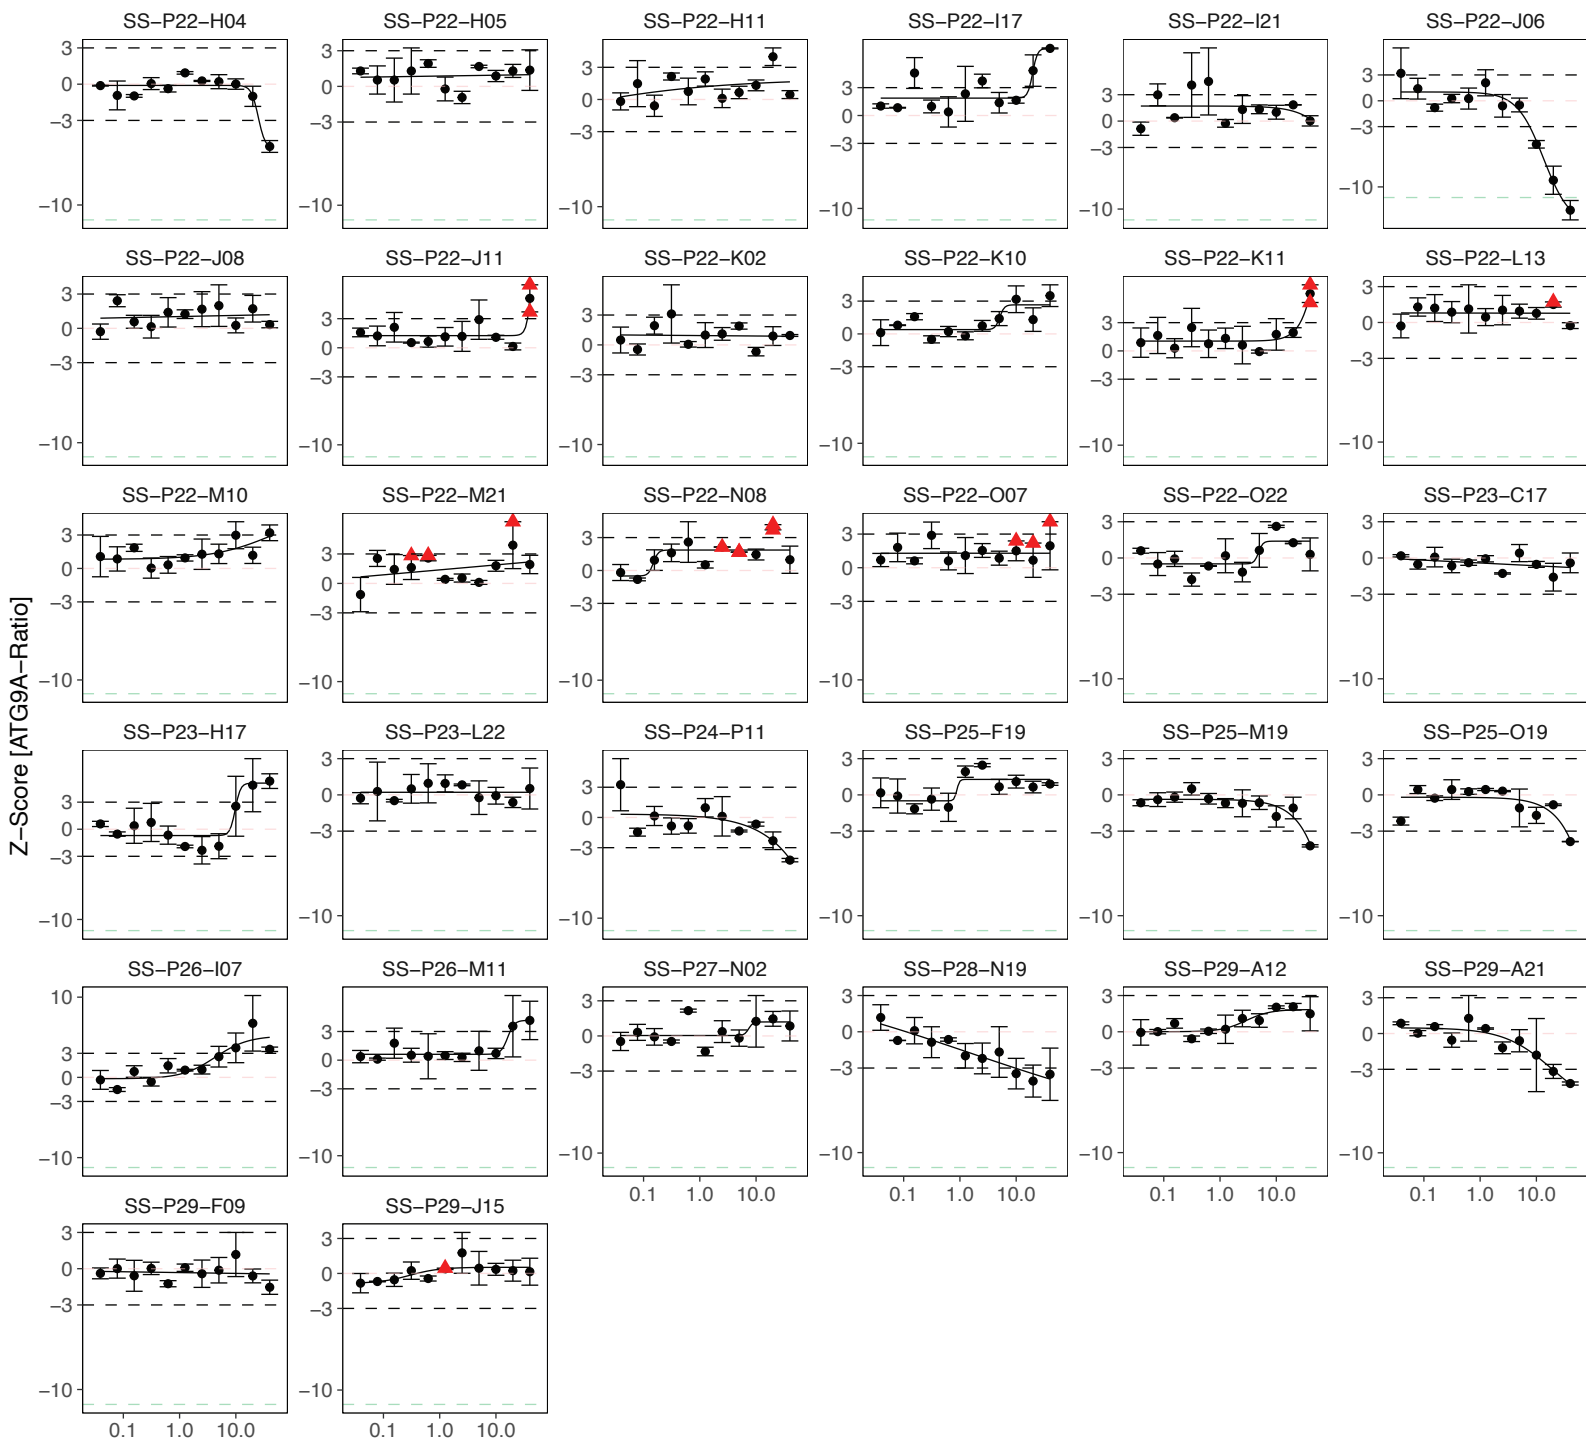


Secondary Screen – Plate 5

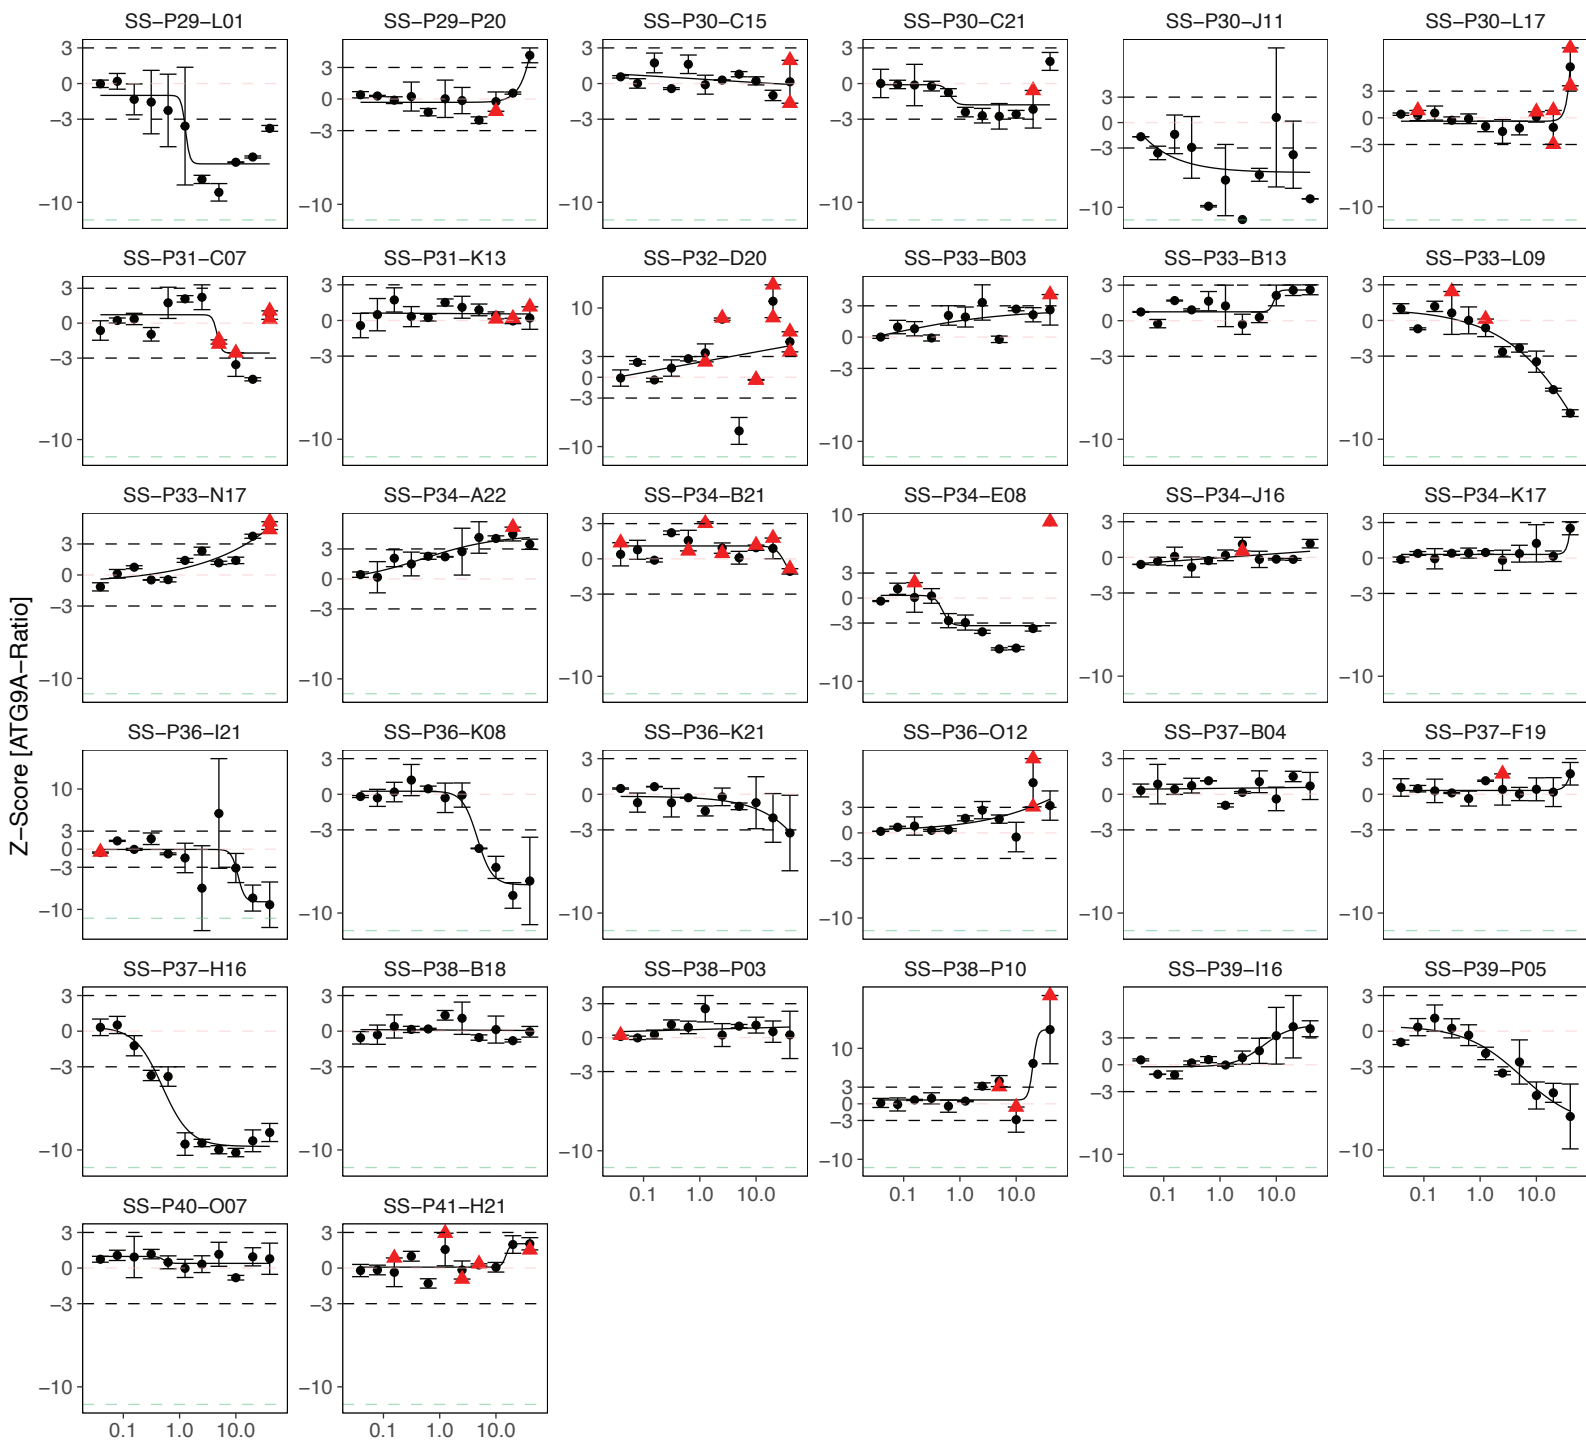


Secondary Screen – Plate 6

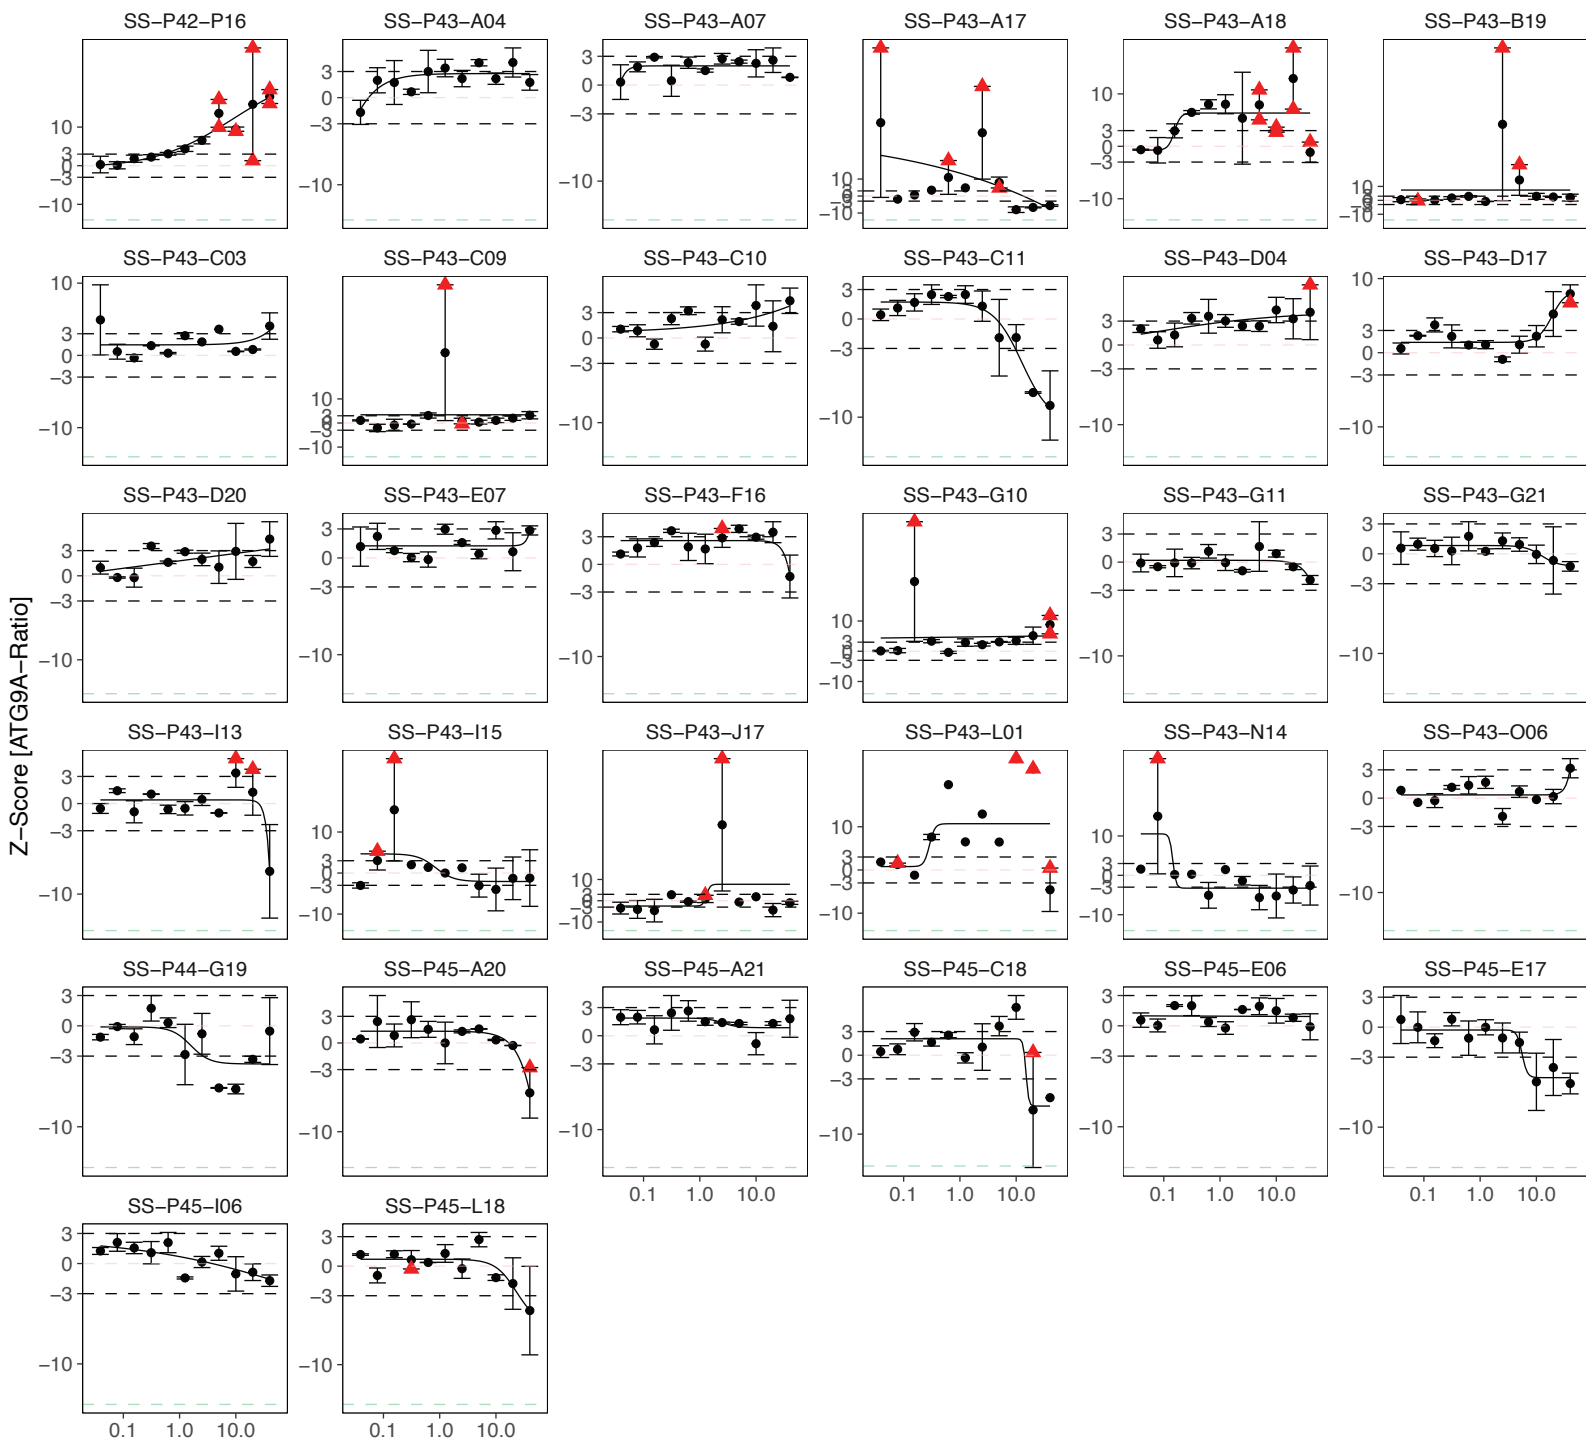


Secondary Screen – Plate 7

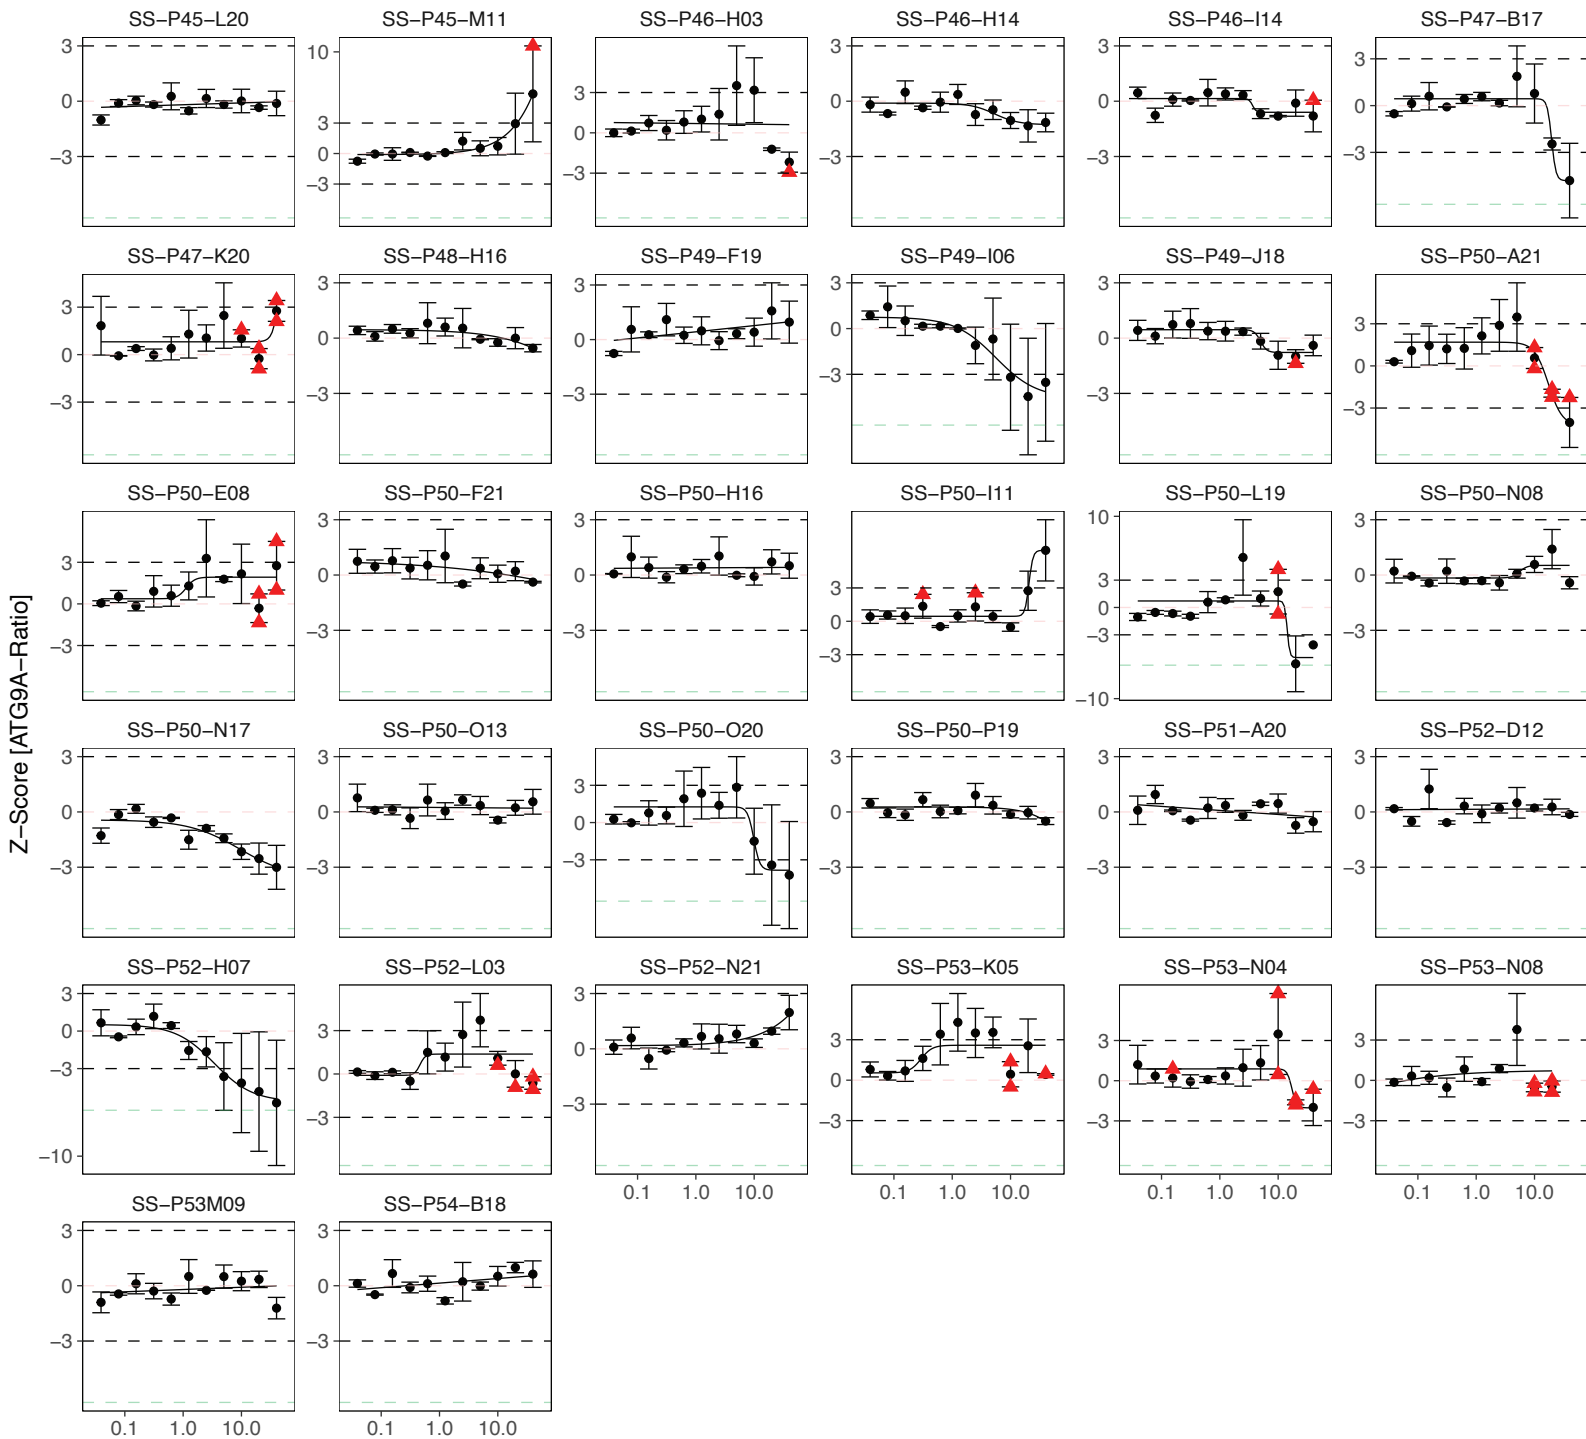


Secondary Screen – Plate 8

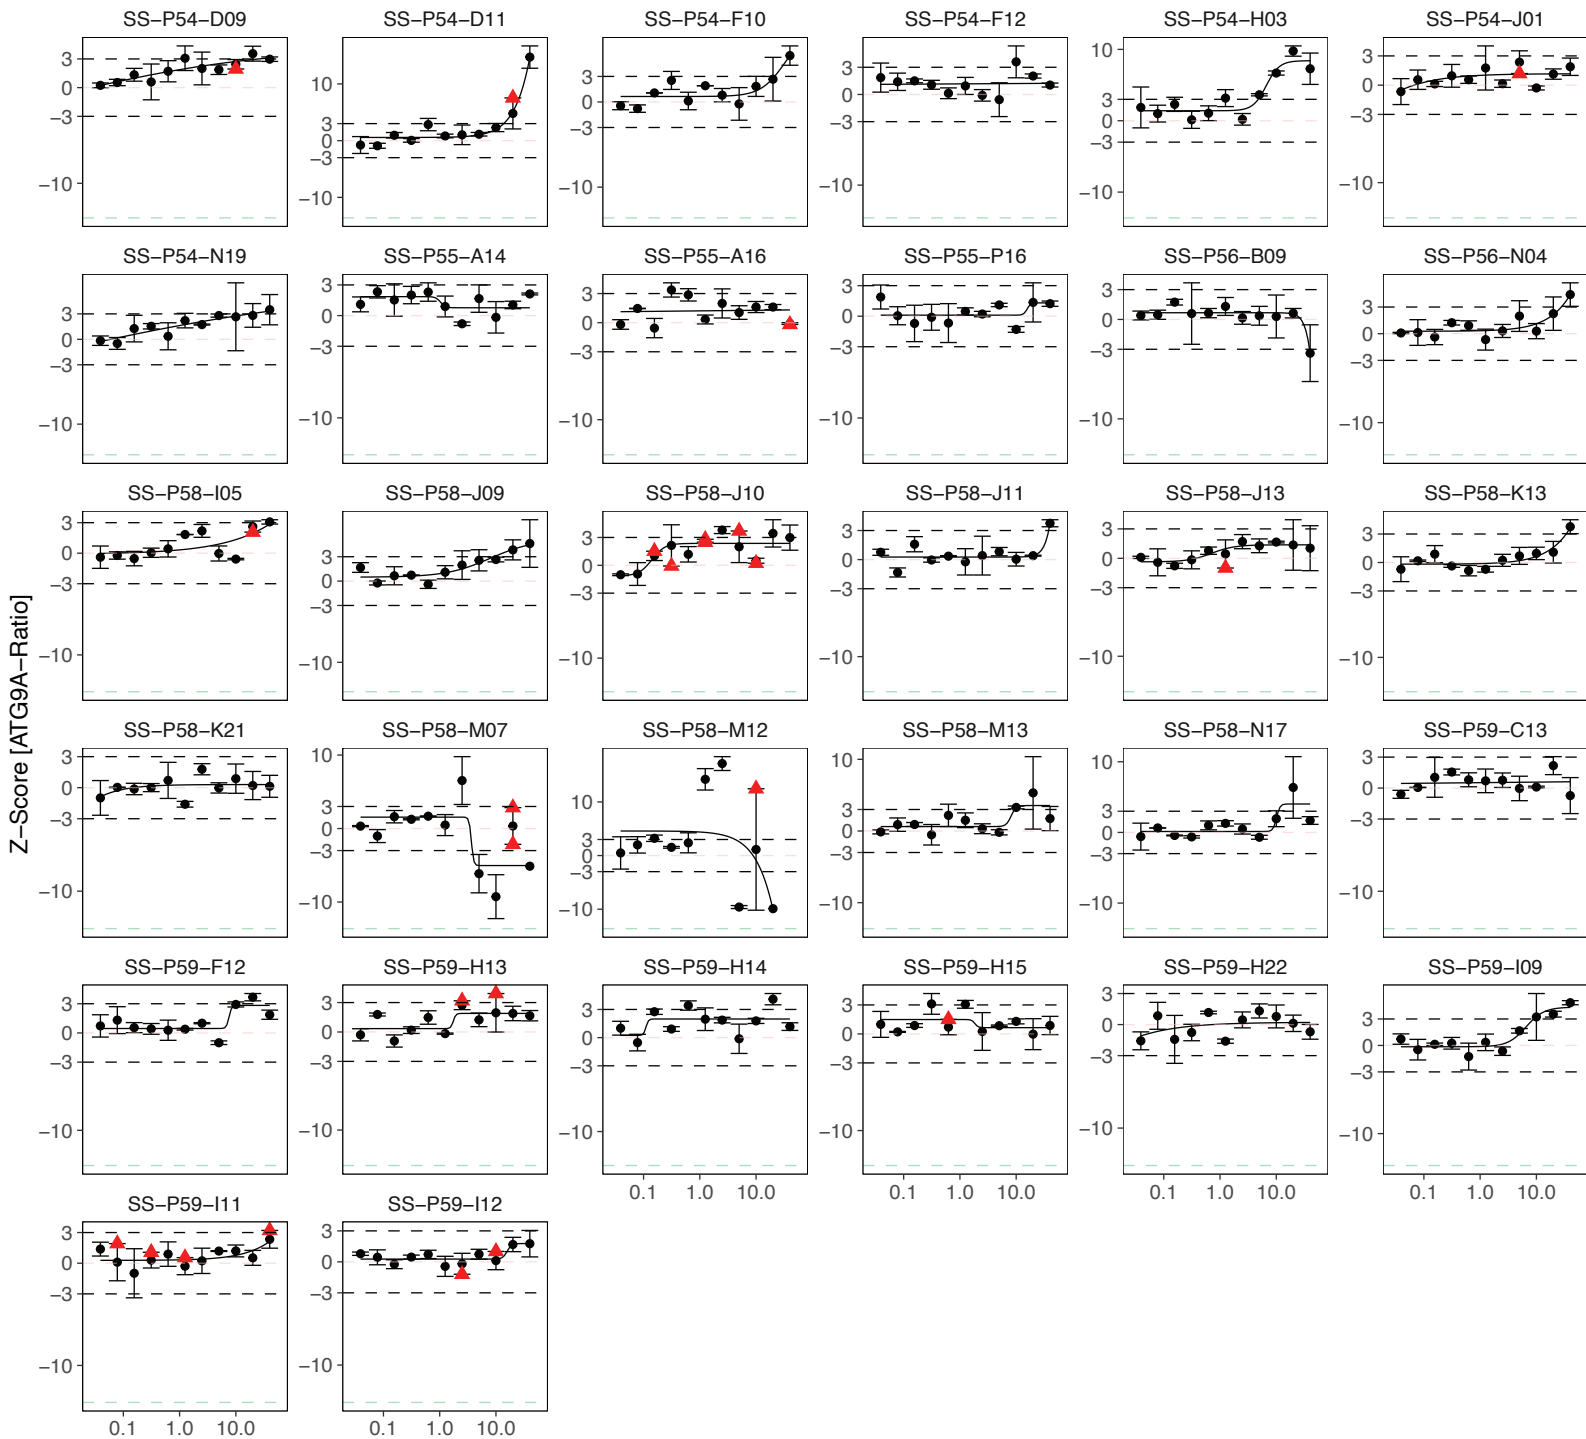


Secondary Screen – Plate 9

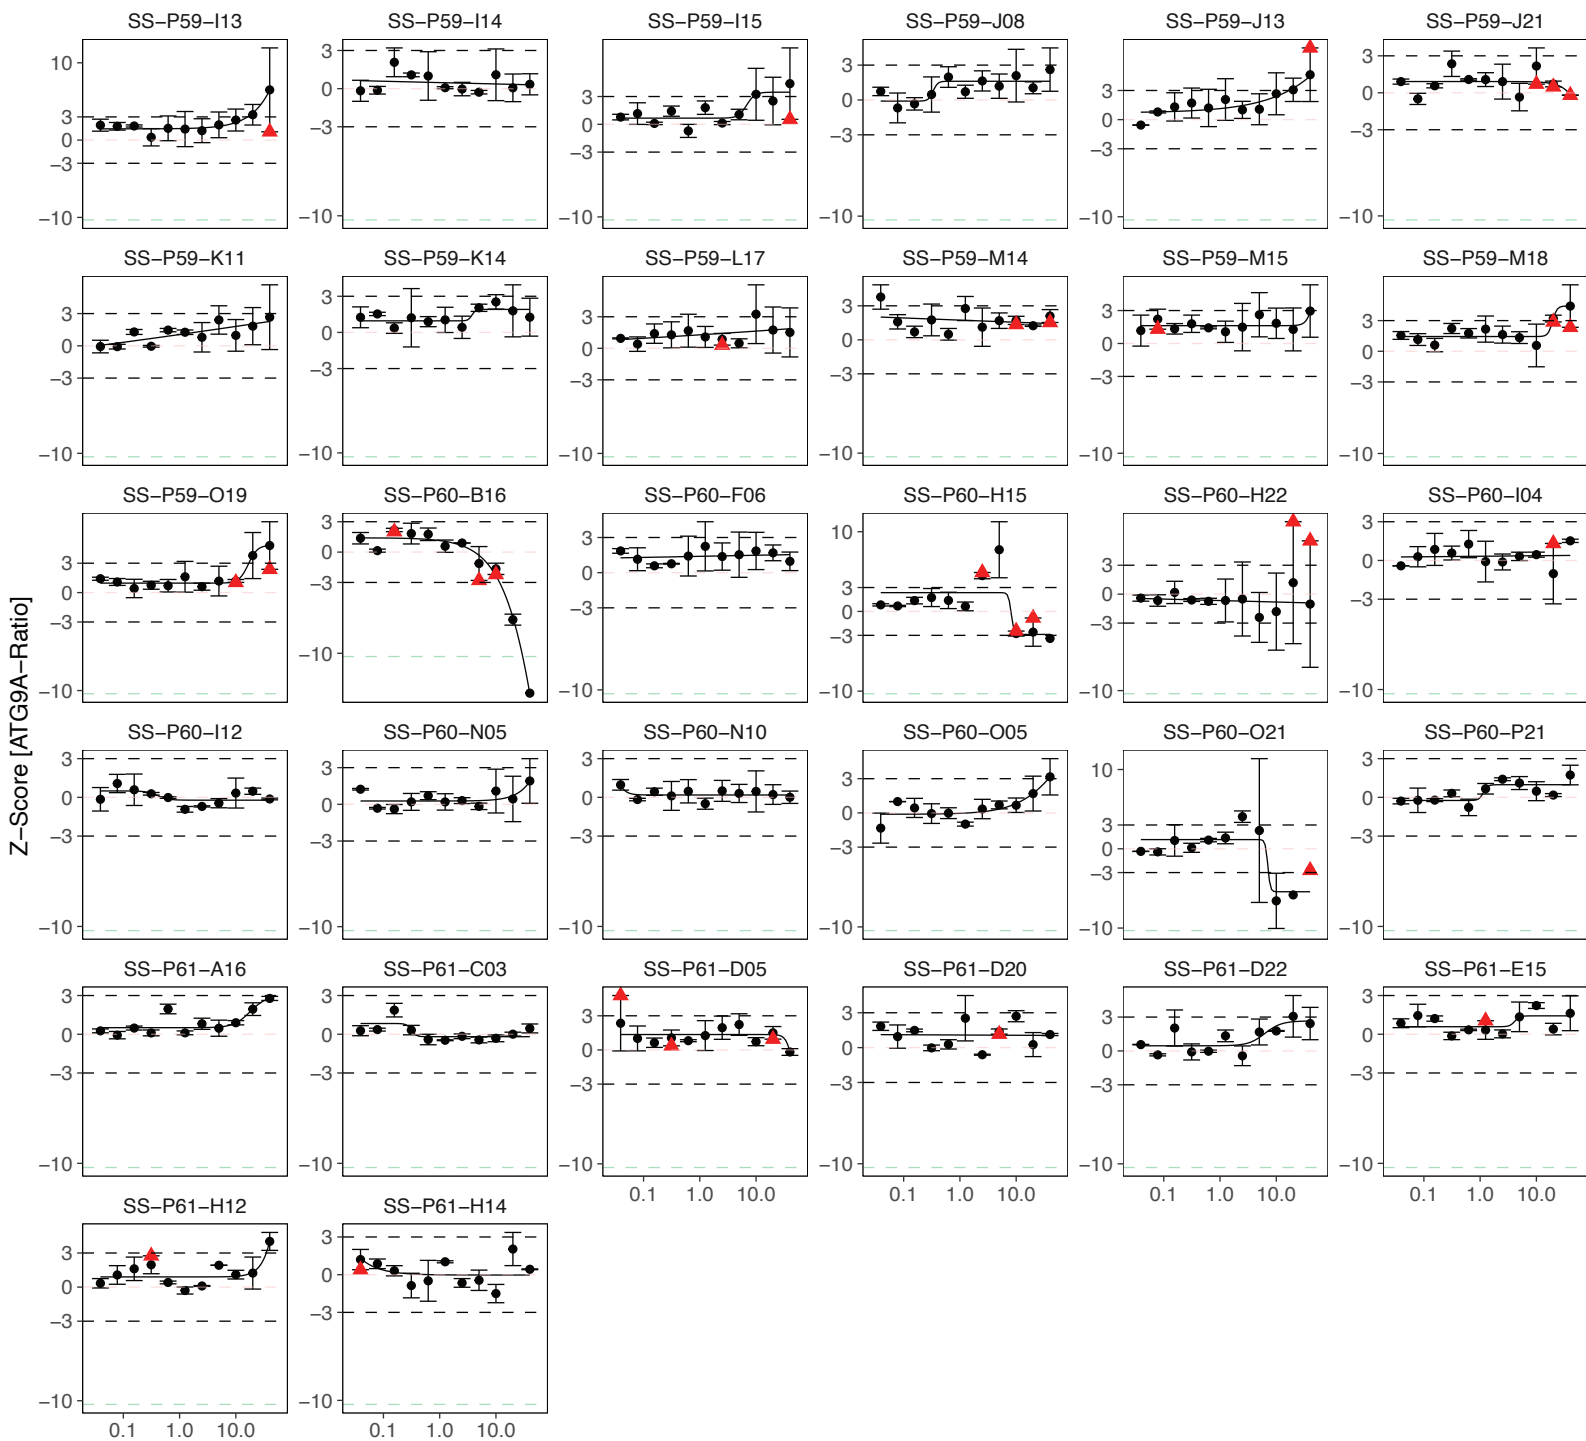


Secondary Screen – Plate 10

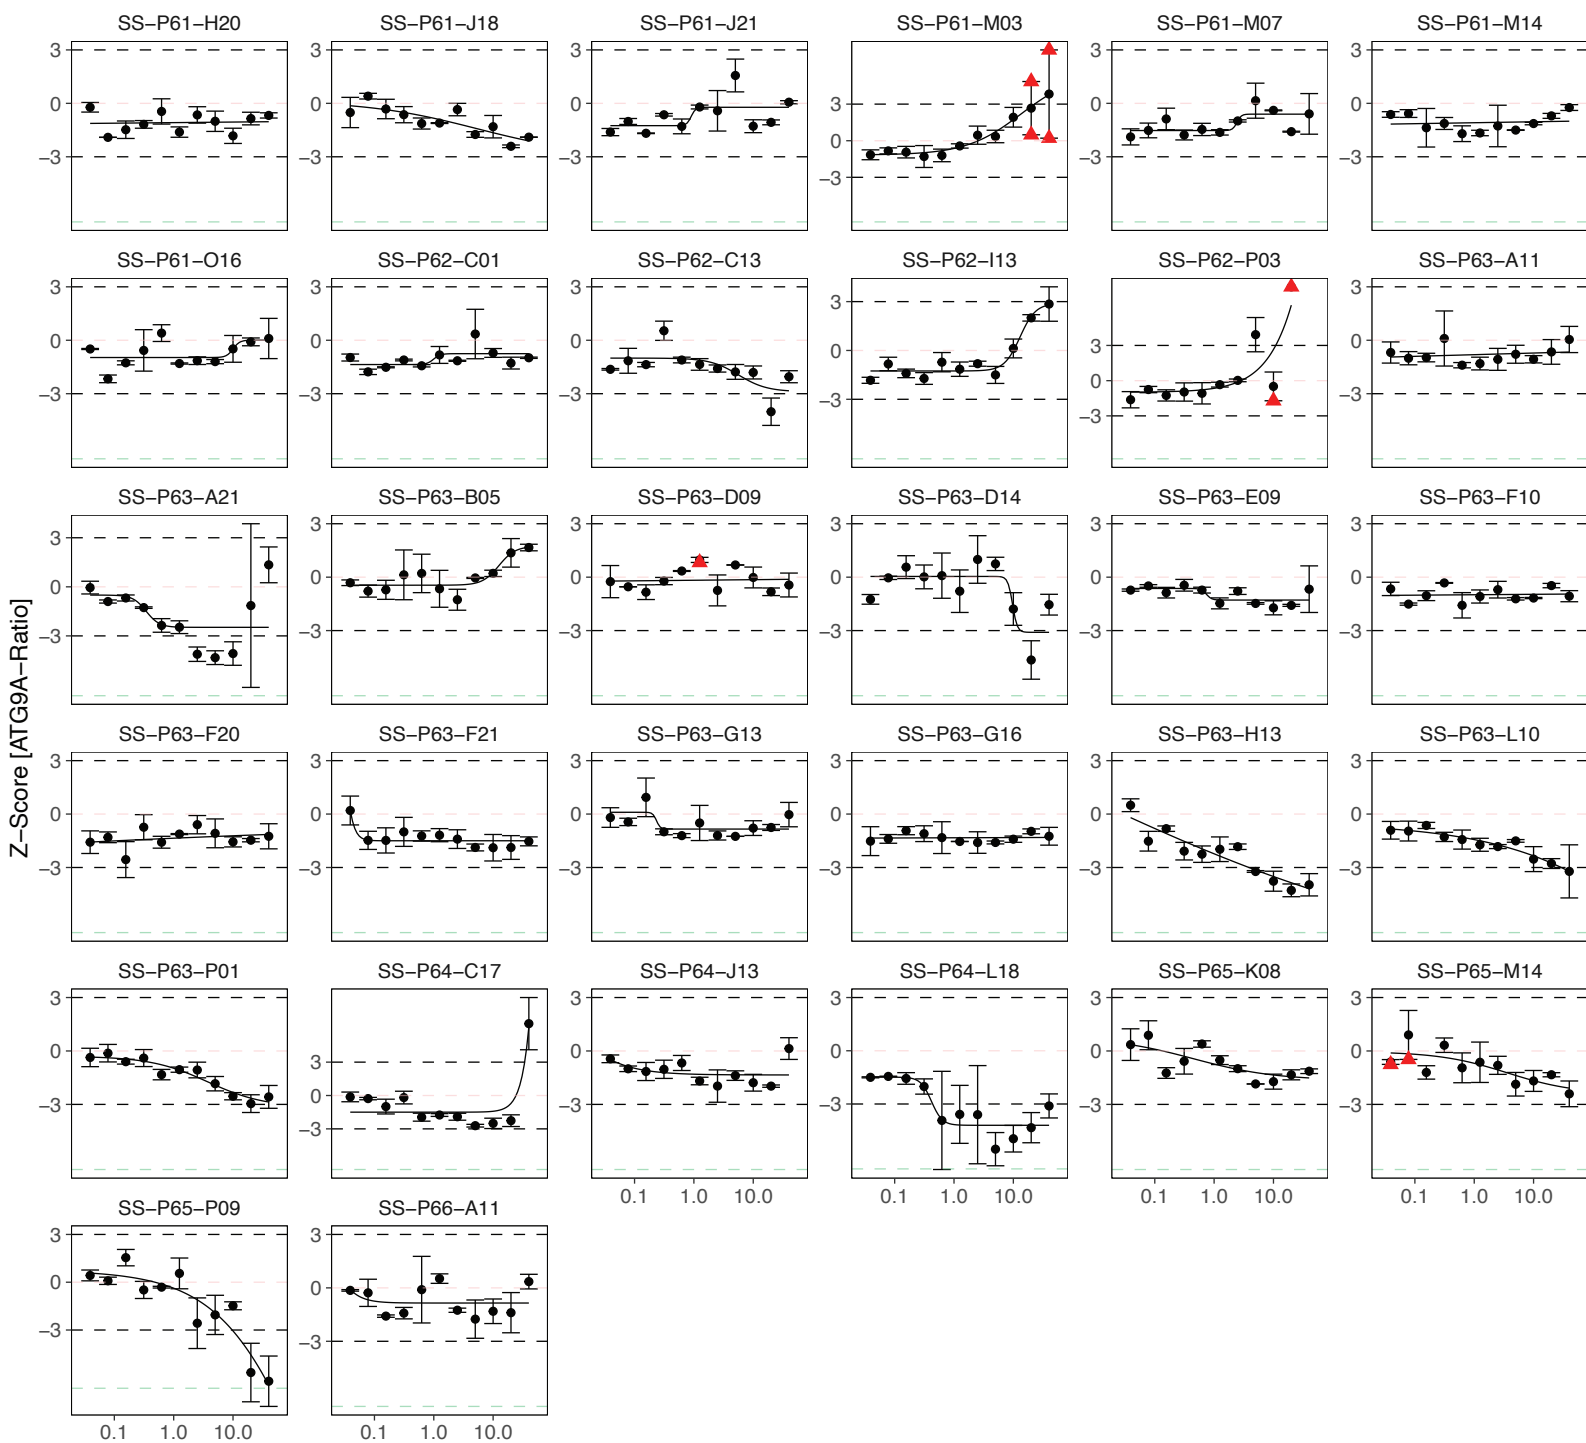


Secondary Screen – Plate 11

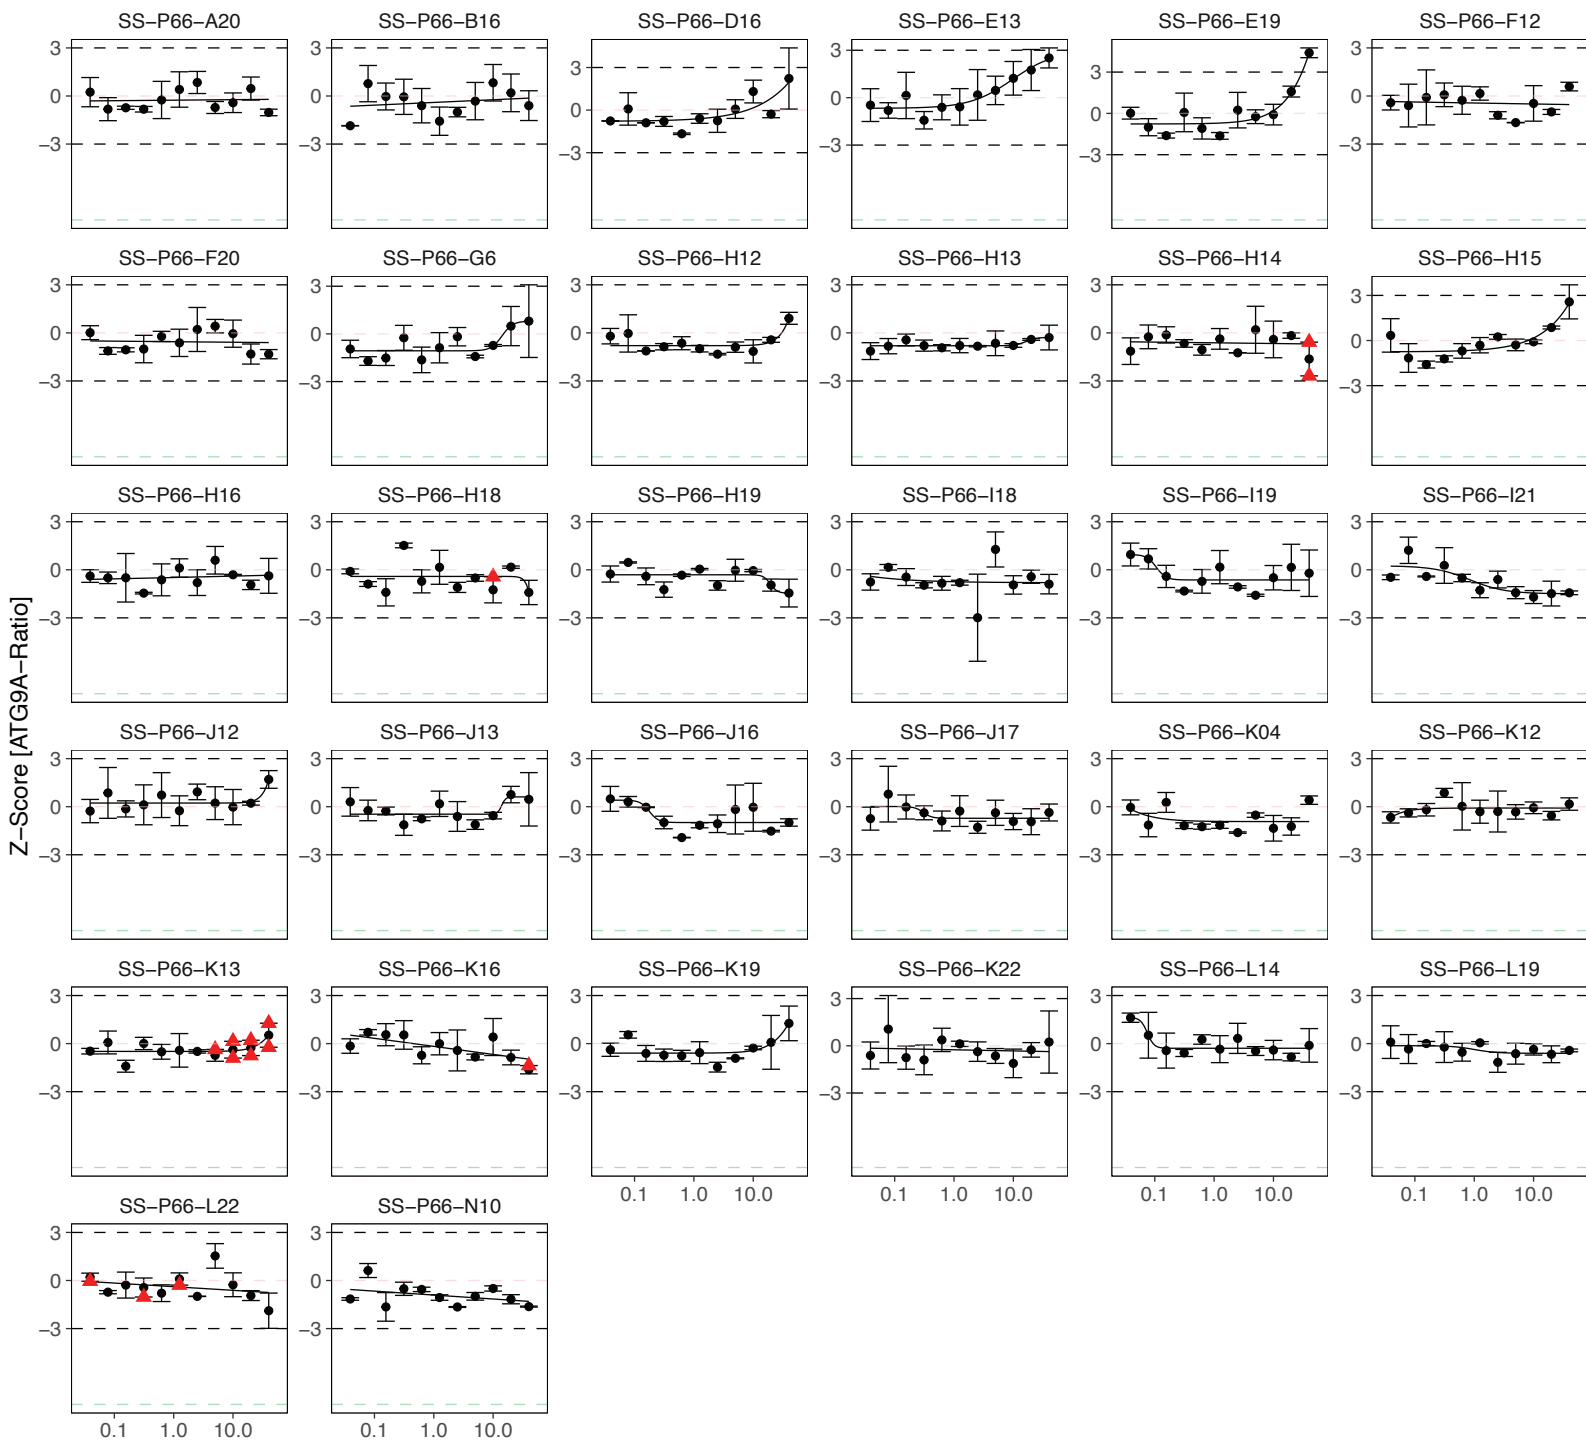


Secondary Screen – Plate 12

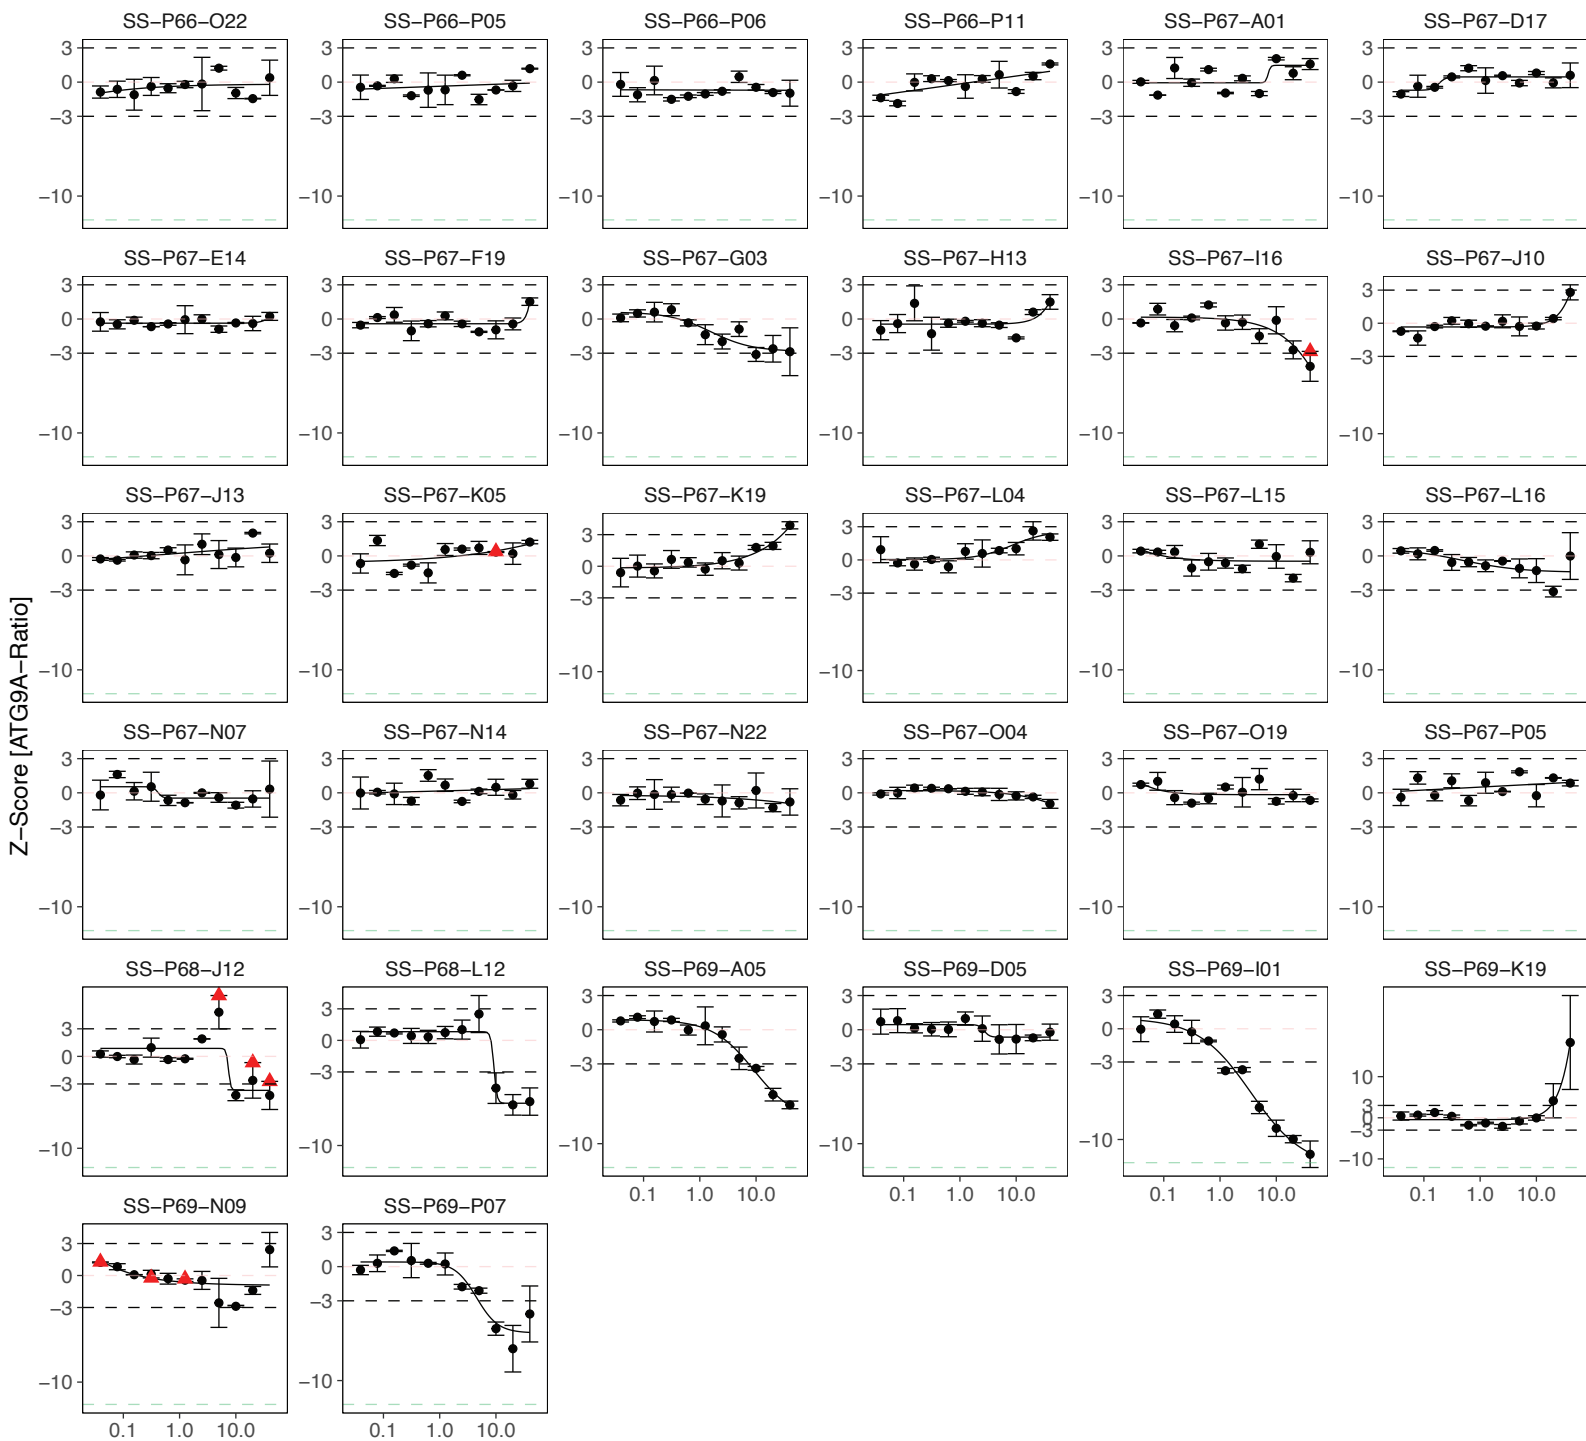

Secondary Screen – Plate 13

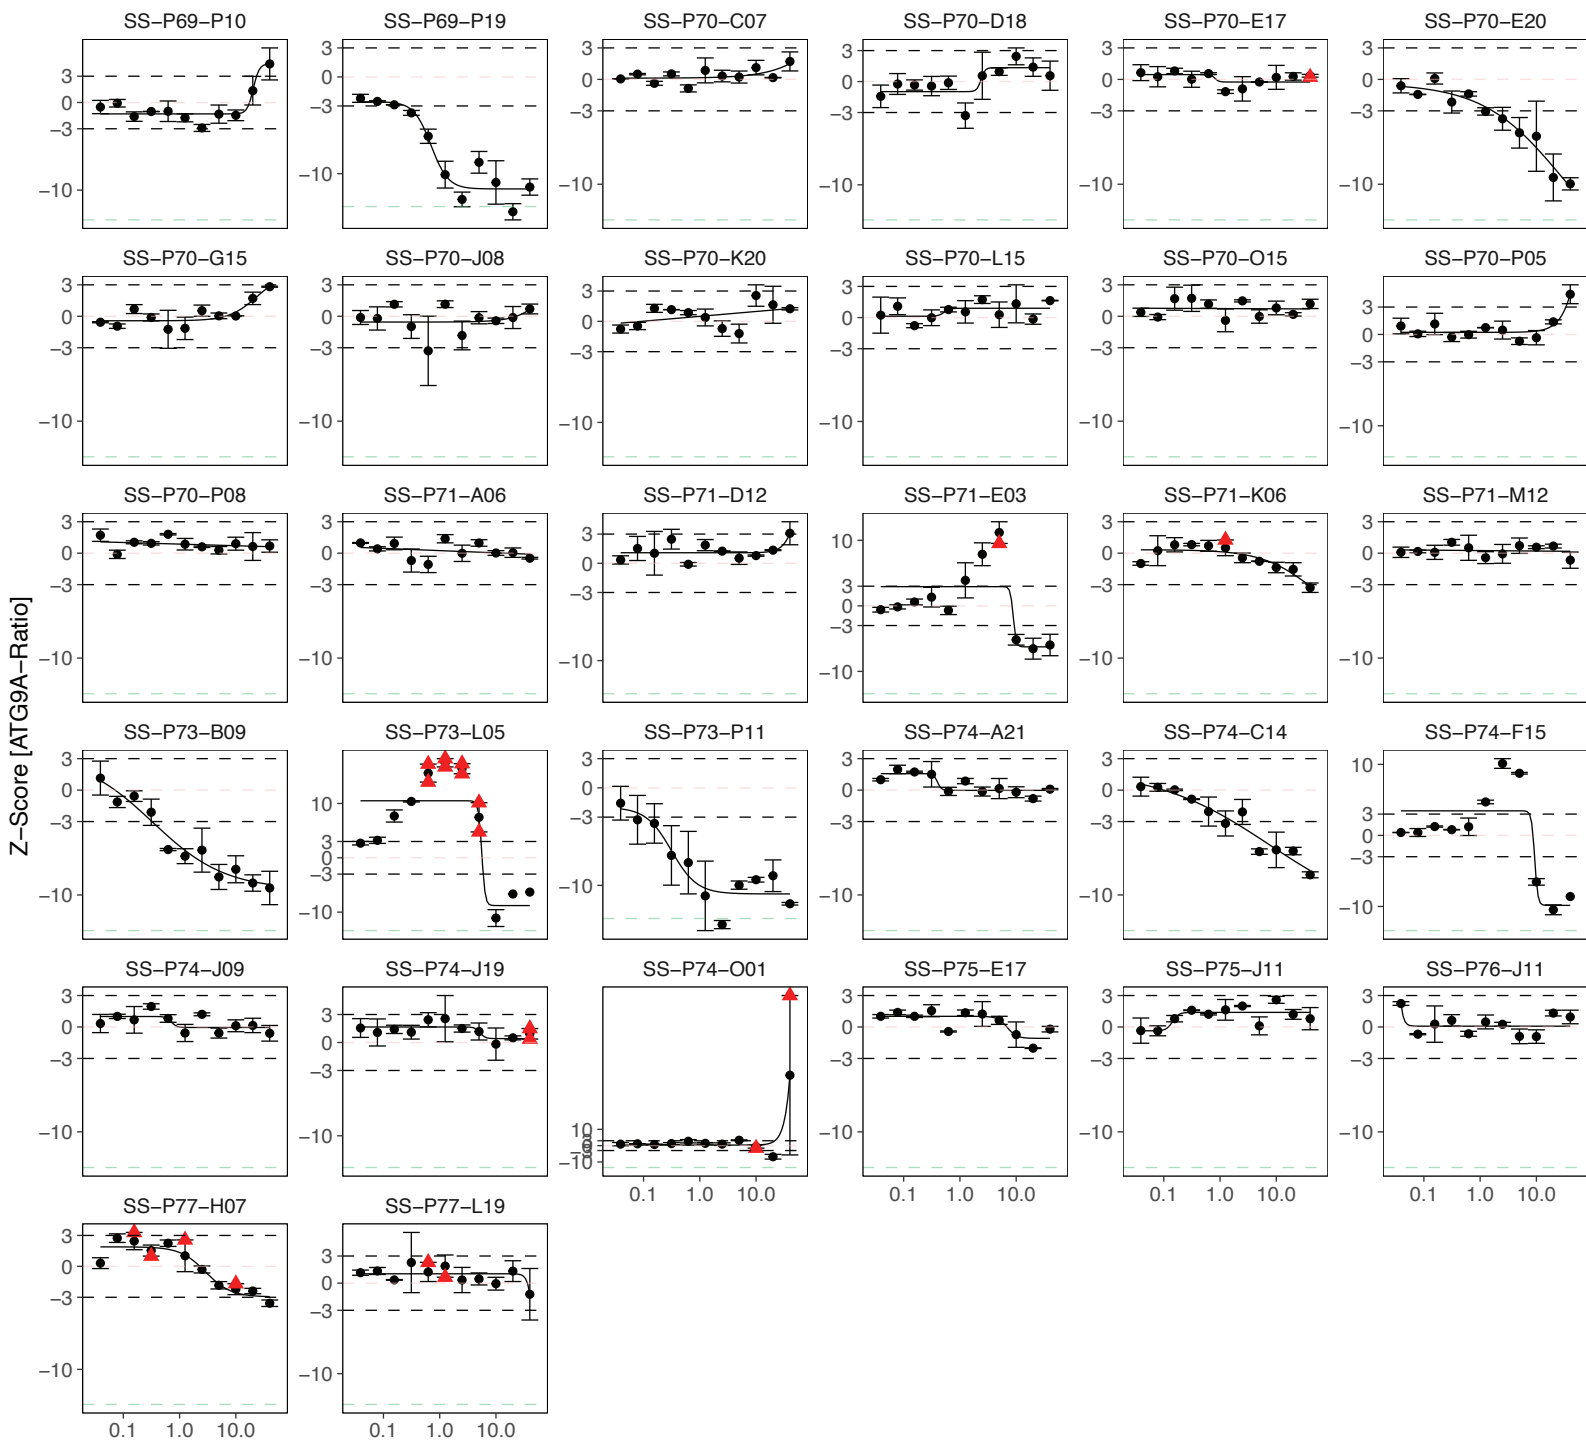

Secondary Screen – Plate 14

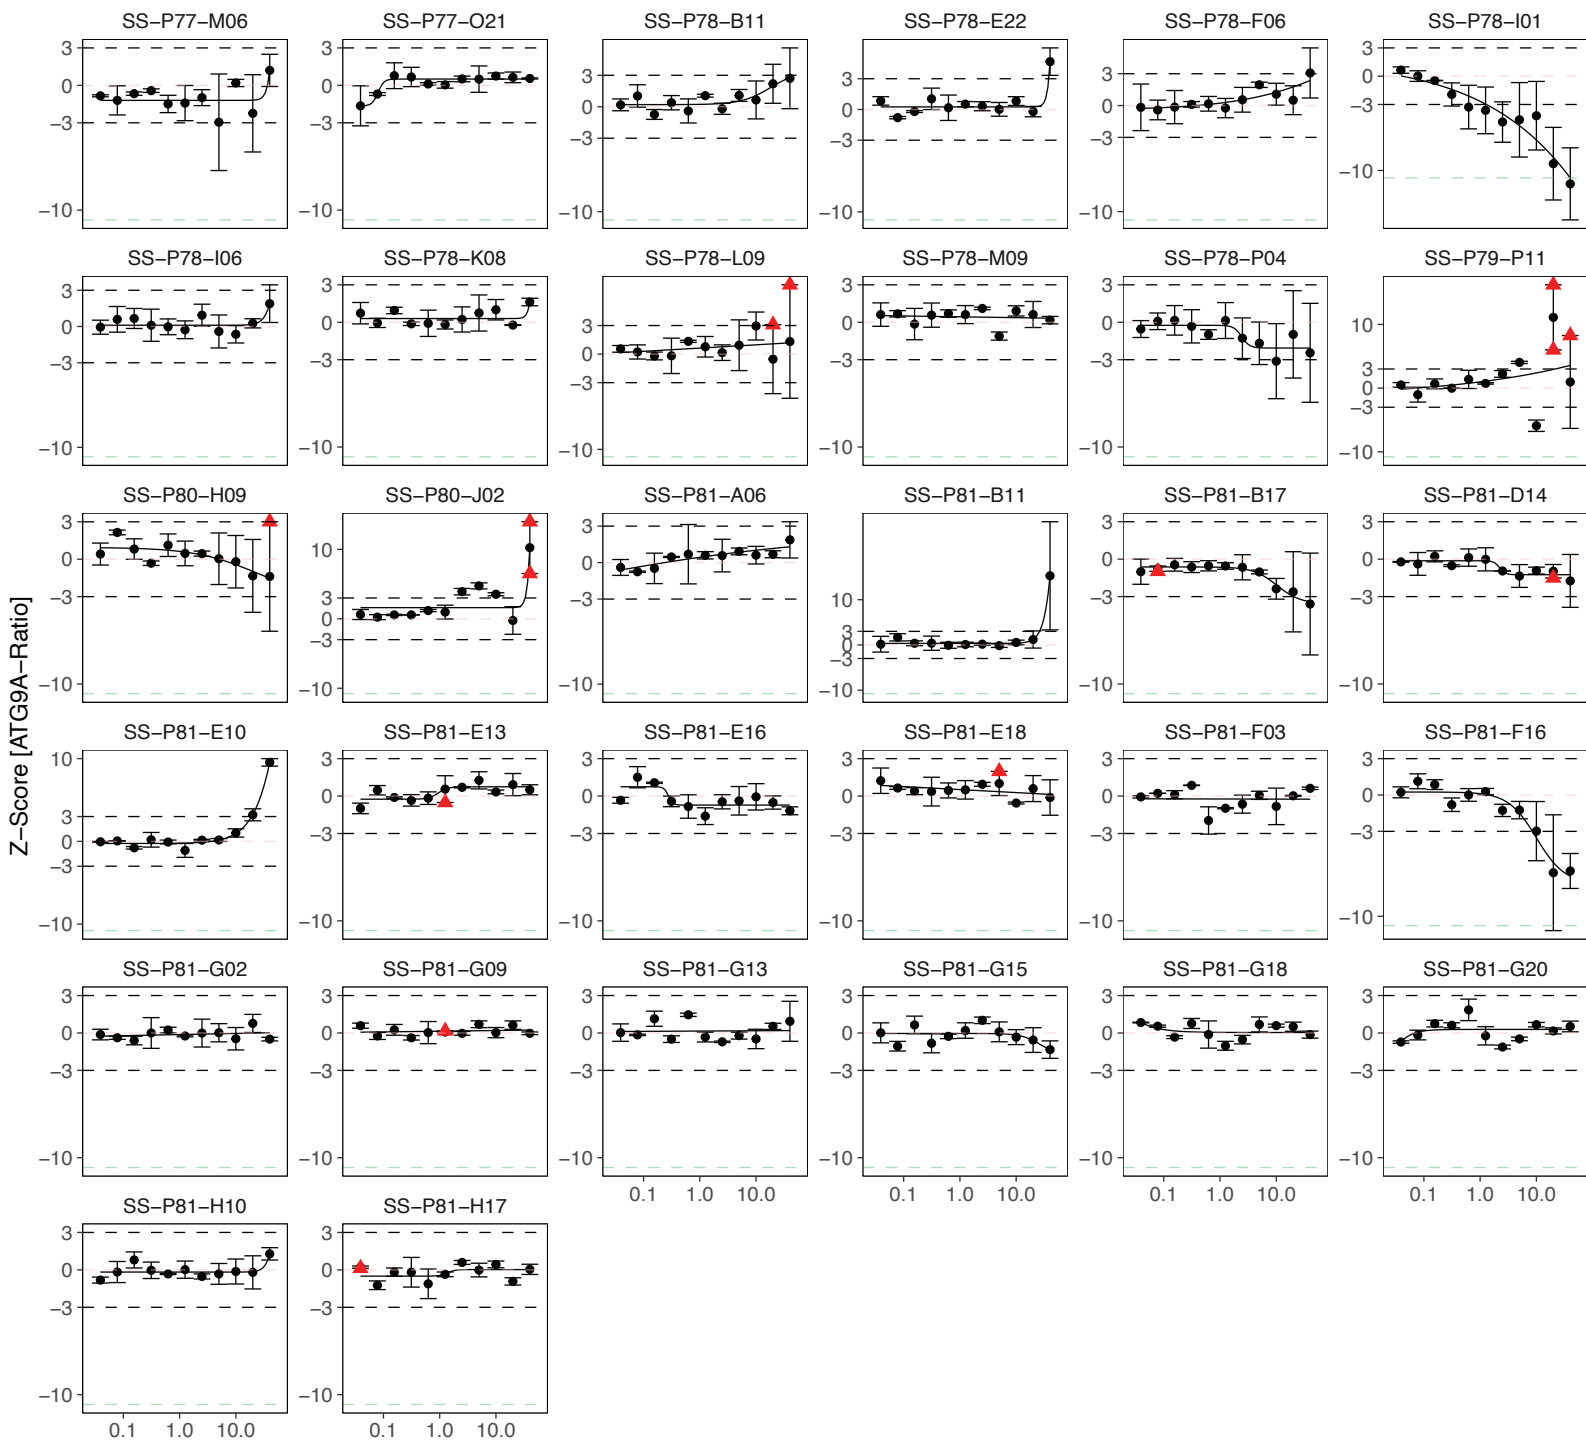

Secondary Screen – Plate 15

