Figure S1

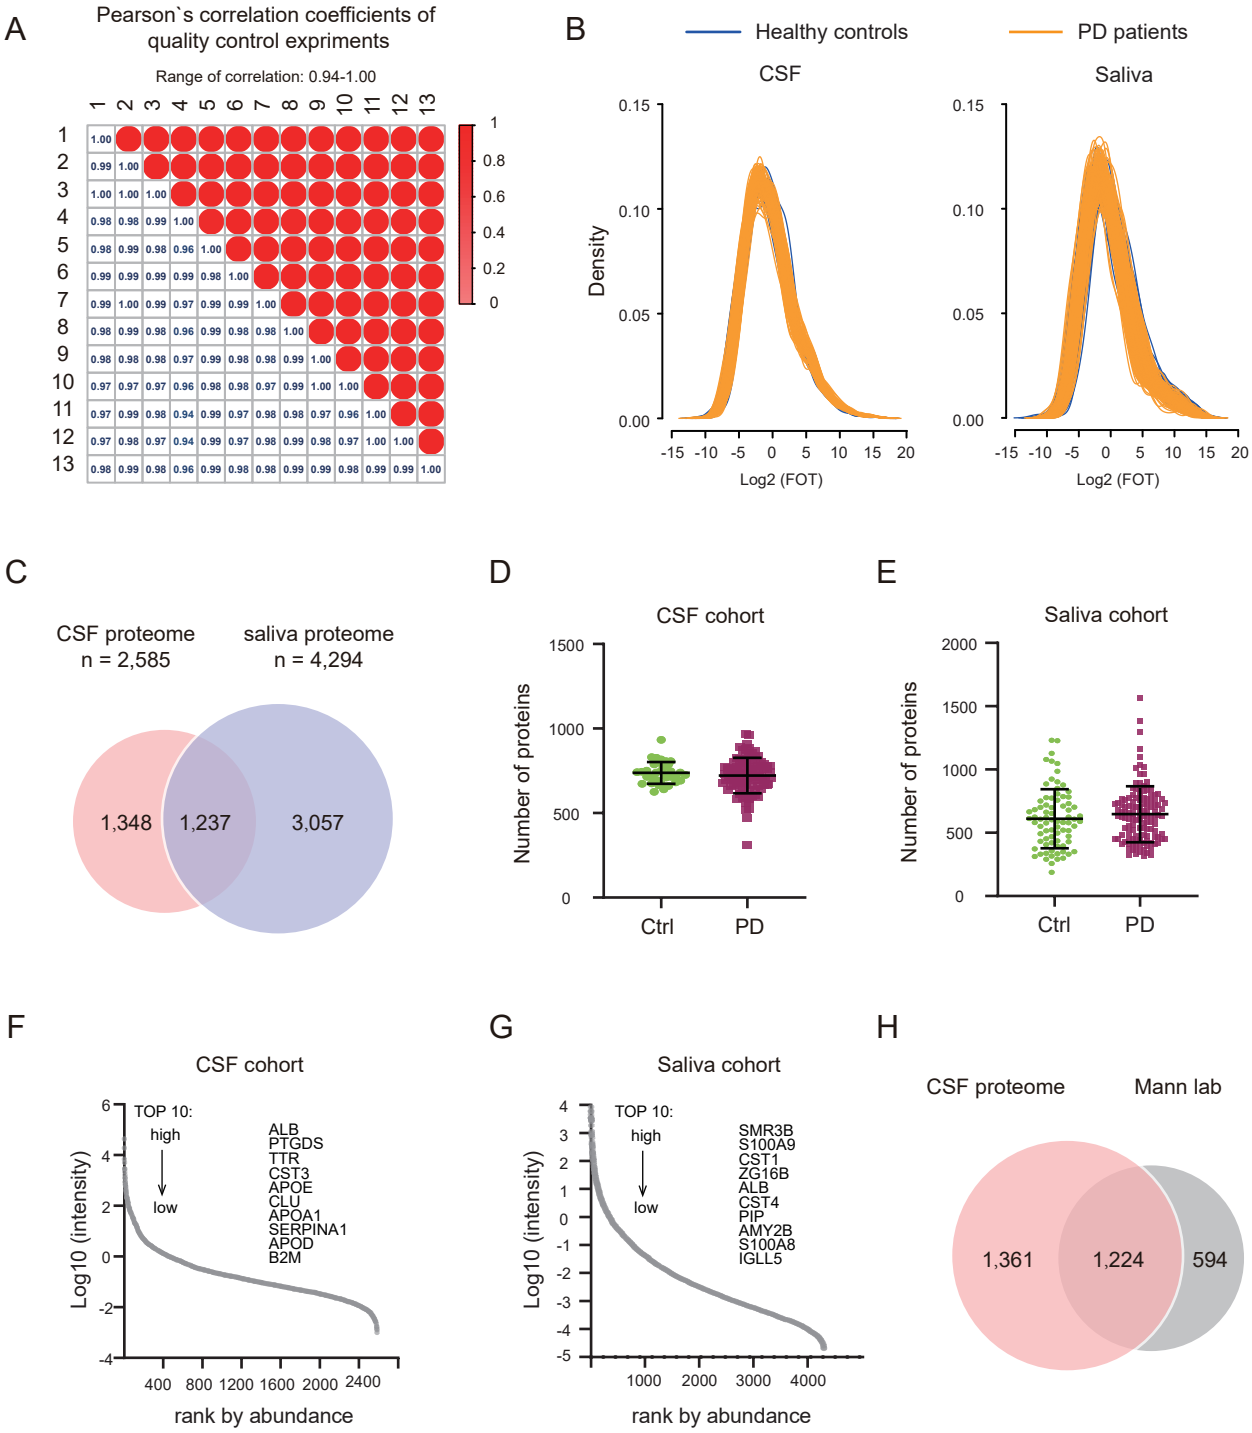
A
Pearson`s correlation coefficients of quality control expriments
Range of correlation: 0.94-1.00
B
Healthy controls
PD patients
CSF
Saliva
Density
Log2 (FOT)
C
CSF proteome n = 2,585
saliva proteome n = 4,294
1,348
1,237
3,057
D
CSF cohort
Number of proteins
Ctrl
PD
E
Saliva cohort
Number of proteins
Ctrl
PD
F
CSF cohort
TOP 10:
high
low
ALB
PTGDS
TTR
CST3
APOE
CLU
APOA1
SERPINA1
APOD
B2M
Log10 (intensity)
rank by abundance
G
Saliva cohort
TOP 10:
high
low
SMR3B
S100A9
CST1
ZG16B
ALB
CST4
PIP
AMY2B
S100A8
IGLL5
Log10 (intensity)
rank by abundance
H
CSF proteome
Mann lab
1,361
1,224
594