



Feeder1 selected bus and line validation

phase a phase b phase c OPF Power flow using OpenDSS


Hierarchical: bus feeder1_3155 voltage

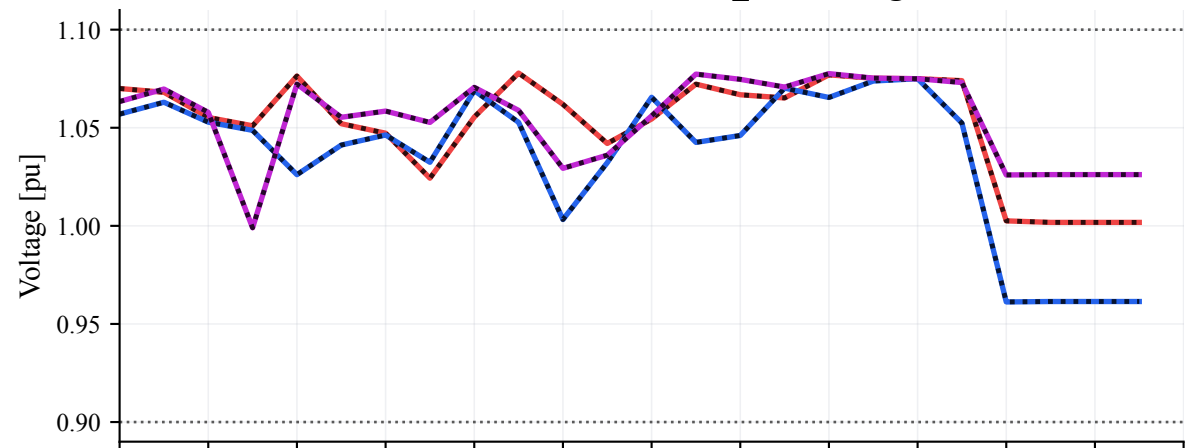

Hierarchical: line feeder1_line1 current

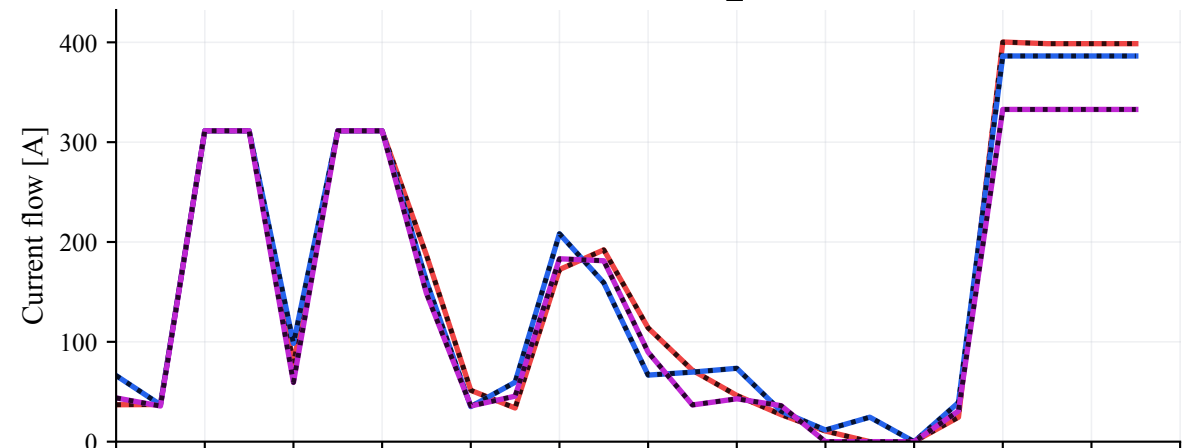

Centralized: bus feeder1_3155 voltage

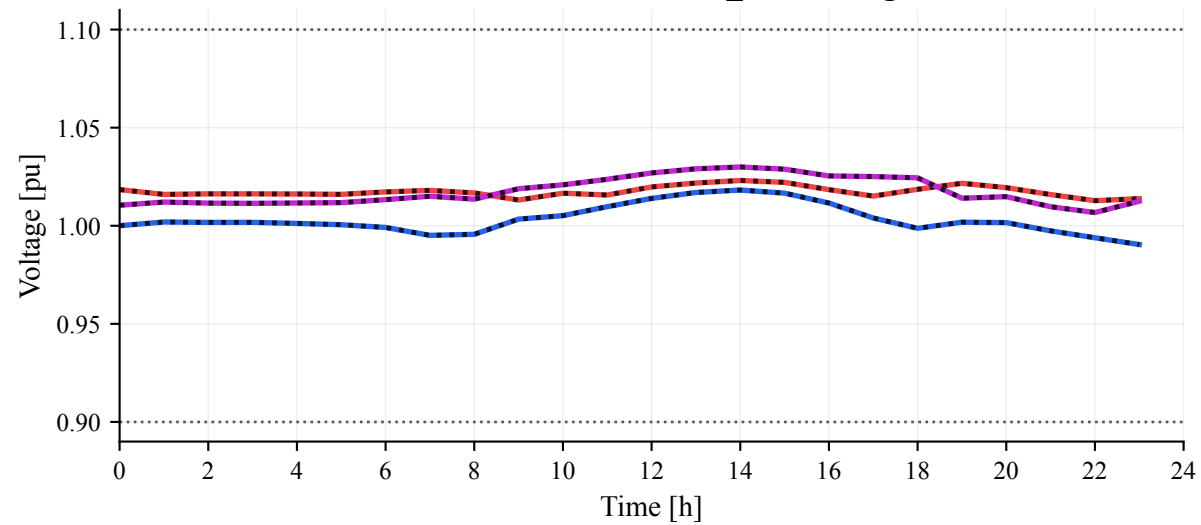

Centralized: line feeder1_line1 current

